

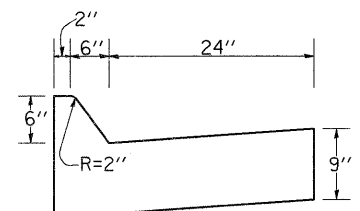



STANDARD INLET FOR CURB & GUTTER TYPE M-6.24

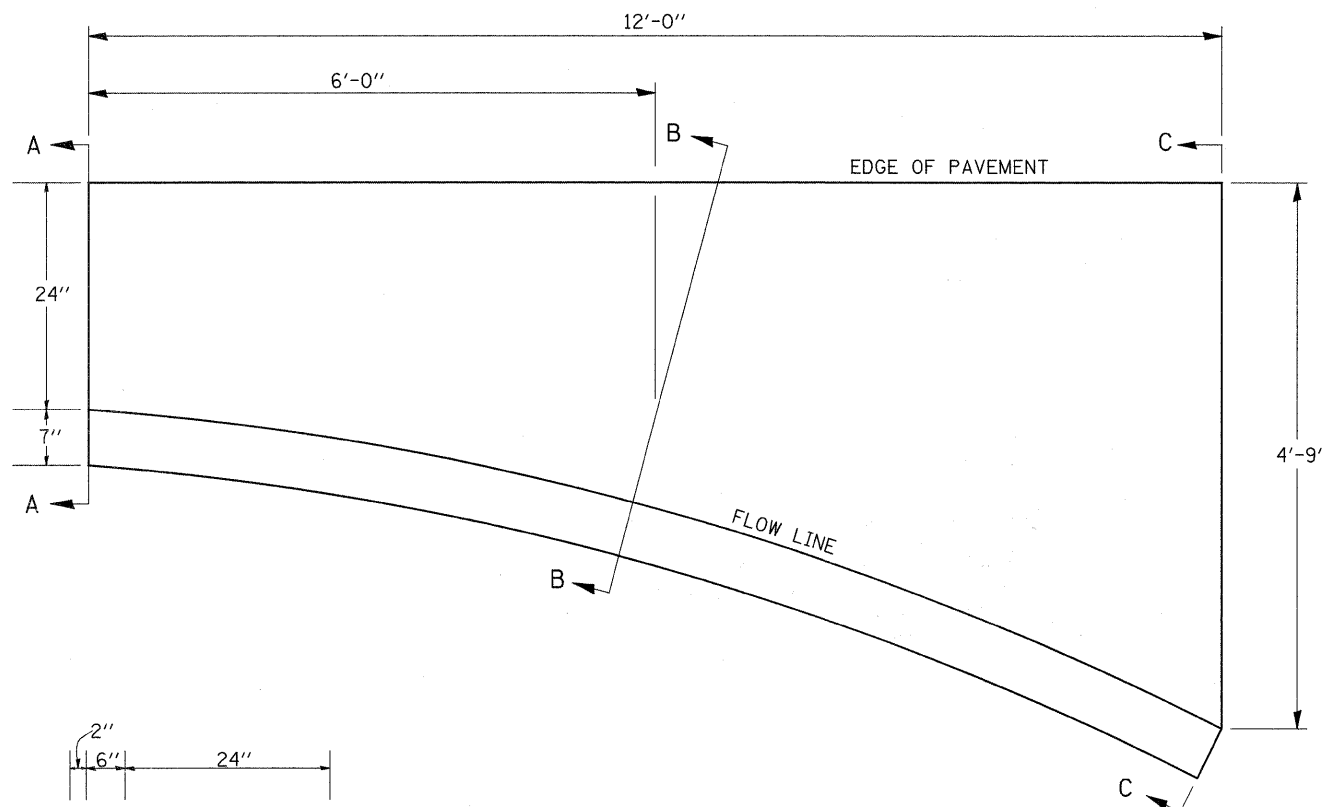

SECTION A-A

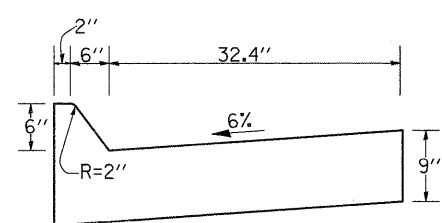

SECTION B-B

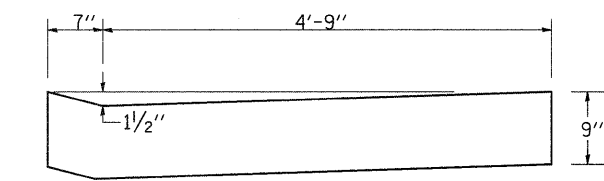

SECTION C-C

NOTES

Class SI Concrete shall be used throughout.


The Curb and Gutter inlet will be paid for at the contract unit price per cubic yard for Class SI Concrete (OUTLETS).

Joints shall be constructed in accordance with the requirements of Article 606.07 of the Standard Specifications.

When curb and gutter is constructed adjacent to flexible pavement, a 1" expansion joint shall be installed at construction joints.

- QUANTITY -
Section A-A to C-C
(1.23 Cu. Yds.)
Class SI Concrete

DETAIL OF SHOULDER AT GUARD RAIL

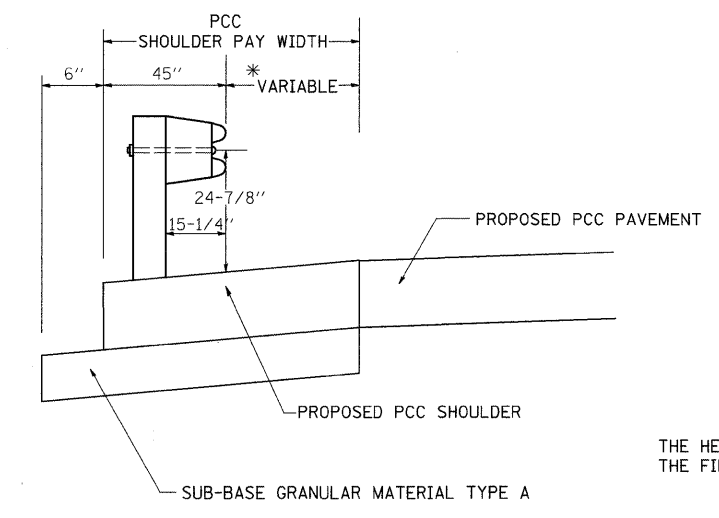


* STA. 604+50 - STA. 637+08 4'
STA. 676+59 - STA. 679+98.35 8'

GENERAL NOTES

THE HEIGHT OF THE GUARD RAIL SHALL BE SET 24 7/8 INCHES FROM THE FINISHED SURFACE.

DETAIL OF SHOULDER AT GUARD RAIL


DRAIN FOR AGGREGATE BASE COURSE

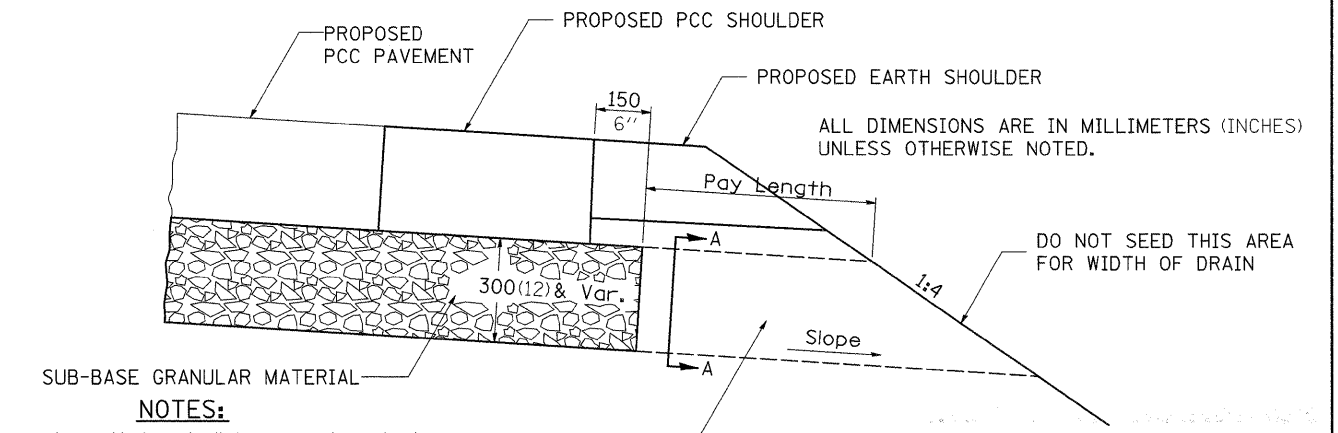

NOTES:

The rock outlets shall be constructed using CA7 and will be paid for at the contract unit price per m² (SQ. YD.) for DRAIN FOR AGGREGATE BASE COURSE. The thickness shall be the same as the adjacent sub-base material as noted on the plans and shall include the cost of the filter fabric. The Rock outlets will be measured in m² (SQ. YD.), the width being 900 (36) by the length shown above. The cost of the CA6 or CA10 under the shoulder shall be included in the contract unit price per m² (SQ. YD.) for SUB-BASE GRANULAR MATERIAL, TYPE A of the thickness specified. The filter fabric to be used shall conform to the filter fabric used for Riprap.

ROCK OUTLET AT ALL LOW POINTS TO BE 900 (36) WIDE AND EXTEND TO FORESLOPE

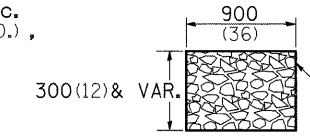

SECTION A-A

NOTE: Slope same as shoulder with 2% min.

REVISED -	REGION 2 / DISTRICT 2 STANDARD	F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
REVISED -		742	37R-3	OGLE	345	222
REVISED -		CONTRACT NO. 84788				
REVISED -		SCALE: 50.0000' / 1" SHEET NO. OF SHEETS STA. TO STA.	FED. ROAD DIST. NO. ILLINOIS FED. AID PROJECT			