


STA. 212+00 TO 219+50
NOTES FOR INFORMATION
PURPOSES ONLY



F.A. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
N/A	06-00017-00-PV	KANE	232	81
STA. 212+00 TO STA. 223+50				
FED. ROAD DIST. NO. ILLINOIS		FED. AID PROJECT		


SCHEDULE OF WATER MAIN STRUCTURES

- 16 VALVE VAULT NO. 16
STA. 212+55, 43.50' R
12" GATE VALVE IN 60" VAULT
RIM = 709.30
- 17 VALVE VAULT NO. 17
STA. 212+40, 38.50' L
12" GATE VALVE IN 60" VAULT
RIM = 709.06
- 18 VALVE VAULT NO. 18
STA. 219+40, 43.50' R
12" GATE VALVE IN 60" VAULT
RIM = 711.30
- 19 VALVE VAULT NO. 19
STA. 219+95, 43.50' L
12" GATE VALVE IN 60" VAULT
RIM = 711.15
- 13 FIRE HYDRANT NO. 13
STA. 212+50, 38.50' R
6" (M.J) AUXILIARY GATE VALVE
AND TRENCH ADAPTOR
GROUND RING ELEV. = 709.20
- 14 FIRE HYDRANT NO. 14
STA. 215+50, 38.50' R
6" (M.J) AUXILIARY GATE VALVE
AND TRENCH ADAPTOR
GROUND RING ELEV. = 710.70
- 15 FIRE HYDRANT NO. 15
STA. 218+50, 38.50' R
6" (M.J) AUXILIARY GATE VALVE
AND TRENCH ADAPTOR
GROUND RING ELEV. = 711.50
- 16 FIRE HYDRANT NO. 16
STA. 221+50, 38.50' R
6" (M.J) AUXILIARY GATE VALVE
AND TRENCH ADAPTOR
GROUND RING ELEV. = 710.30

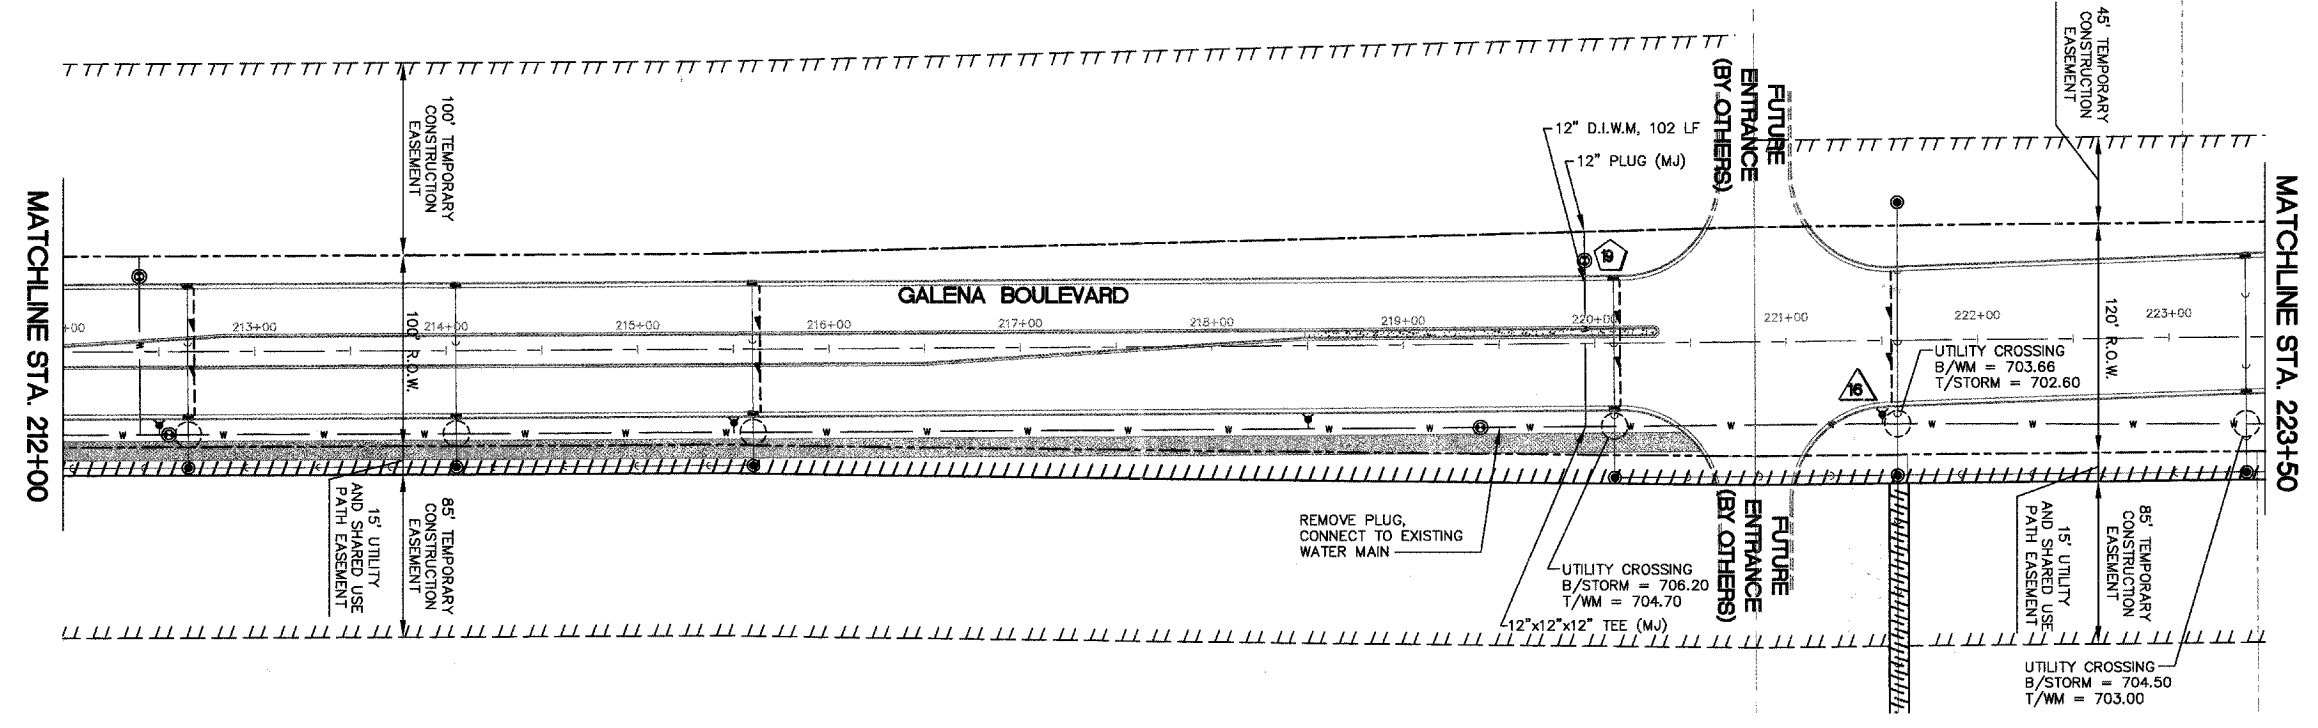

NOTE:
DEPTH OF WATER MAIN IS VARIABLE DEPENDING ON
PROFILE AND GRADES SHOWN. 5.5 FEET IS THE MINIMUM
WATER MAIN DEPTH.

SCALE:
HORZ. 1" = 50'
VERT. 1" = 5'



DATE	BY

PLAN

SURVEYED, PLOTTED, ALIGNED, CHECKED, AND FILED

NOTE BOOK NO. _____

STRUCTURE NO. _____

DATE _____

DATE	BY


PROFILE

SURVEYED, PLOTTED, GRADES CHECKED, AND FILED

NOTE BOOK NO. _____

STRUCTURE NO. _____

DATE _____

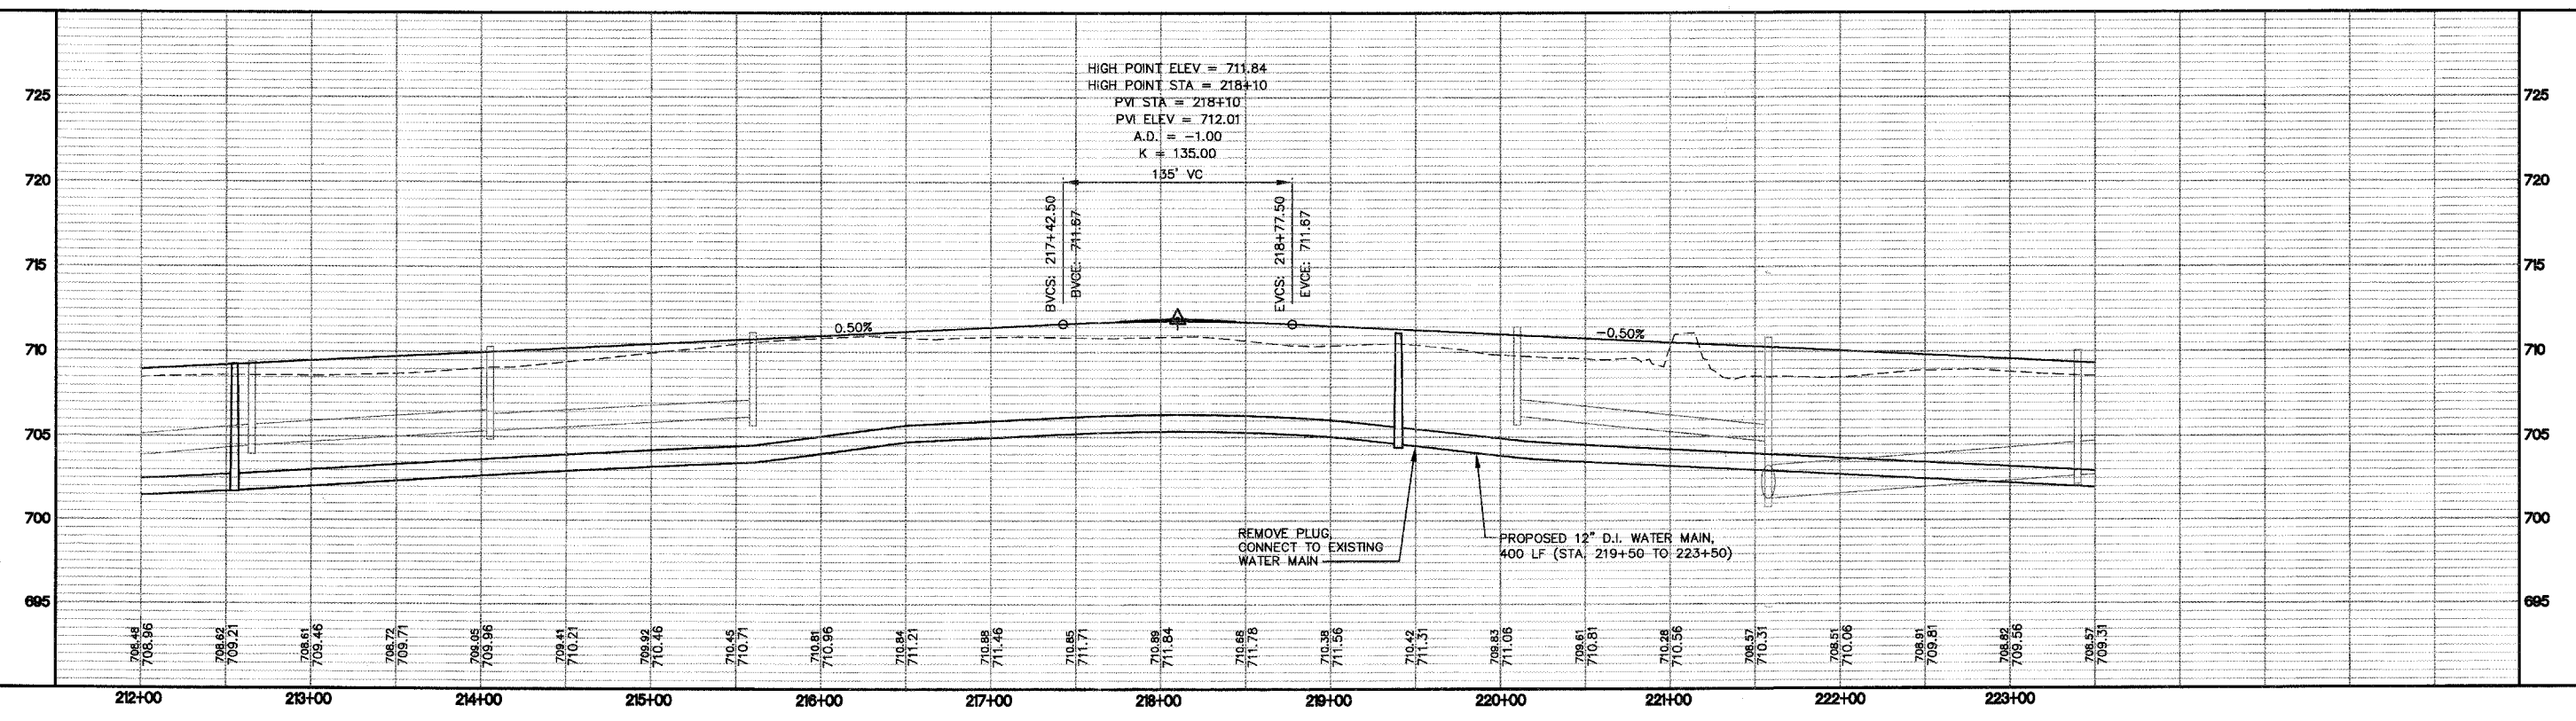

GALENA BOULEVARD WATER MAIN & SANITARY SEWER PLAN