




F.A. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
N/A	06-00017-00-PV	KANE	232	82
STA. 223+50		TO STA. 233+00		
FED. ROAD DIST. NO. _ ILLINOIS		FED. AID PROJECT		


SCHEDULE OF WATER MAIN STRUCTURES

- 20 VALVE VAULT NO. 20
STA. 223+90, 46.10' R
12" GATE VALVE IN 60" VAULT
RIM = 709.25
- 21 VALVE VAULT NO. 21
STA. 225+90, 52.71' L
12" GATE VALVE IN 60" VAULT
RIM = 708.65
- 22 VALVE VAULT NO. 22
STA. 229+51.35, 58.55' R
12" GATE VALVE IN 60" VAULT
RIM = 711.85
- 23 VALVE VAULT NO. 23
STA. 229+61.35, 68.55' R
12" GATE VALVE IN 60" VAULT
RIM = 712.20
- 17 FIRE HYDRANT NO. 17
STA. 223+80, 41.00' R
6" (MJ) AUXILIARY GATE VALVE
AND TRENCH ADAPTOR
GROUND RING ELEV. = 709.20
- 18 FIRE HYDRANT NO. 18
STA. 227+00, 53.50' R
6" (MJ) AUXILIARY GATE VALVE
AND TRENCH ADAPTOR
GROUND RING ELEV. = 709.80
- 19 FIRE HYDRANT NO. 19
STA. 229+41.91, 53.50' R
6" (MJ) AUXILIARY GATE VALVE
AND TRENCH ADAPTOR
GROUND RING ELEV. = 711.67

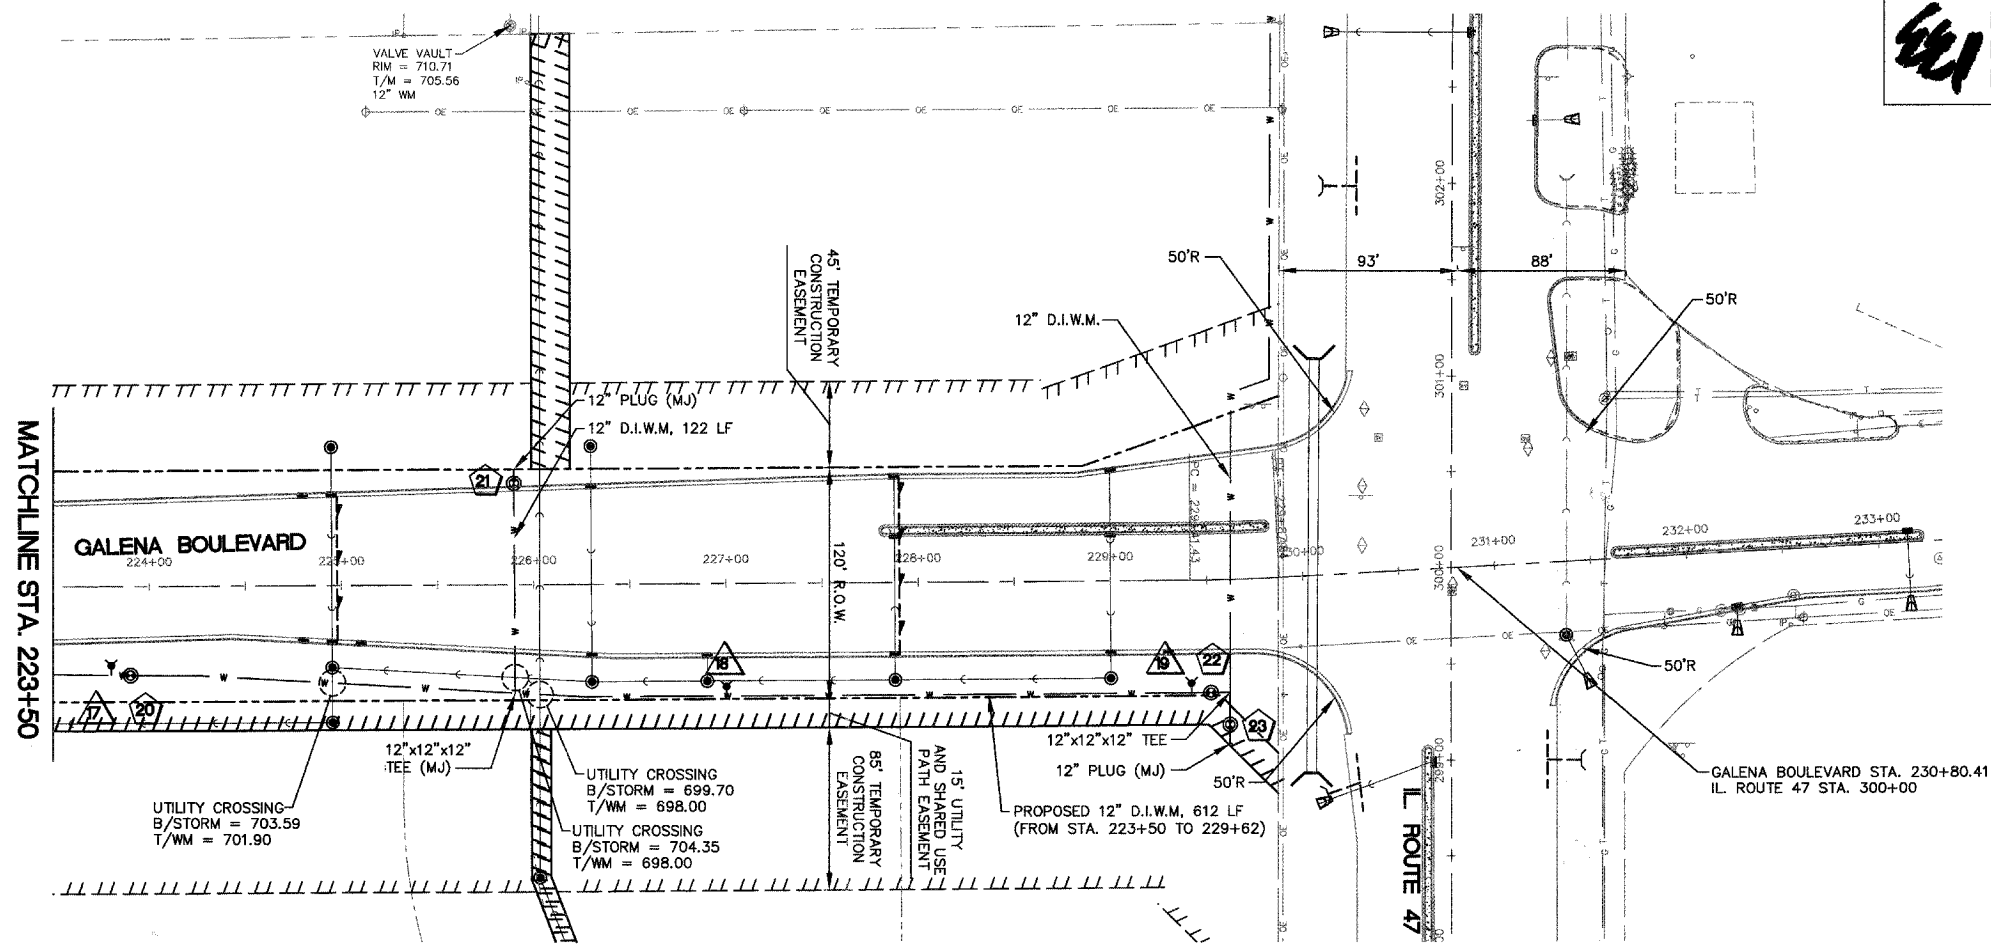


NOTE:
DEPTH OF WATER MAIN IS VARIABLE DEPENDING ON
PROFILE AND GRADES SHOWN. 5.5 FEET IS THE MINIMUM
WATER MAIN DEPTH.

SCALE:
HORZ. 1" = 50'
VERT. 1" = 5'

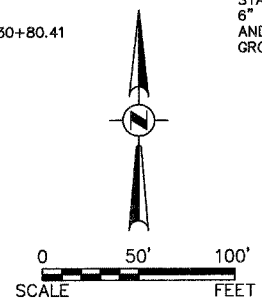

PLAN	DATE
SURVEYED	
PLOTTED	
CHECKED	
BY	
NO.	

PROFILE	DATE
SURVEYED	
PLOTTED	
CHECKED	
BY	
NO.	

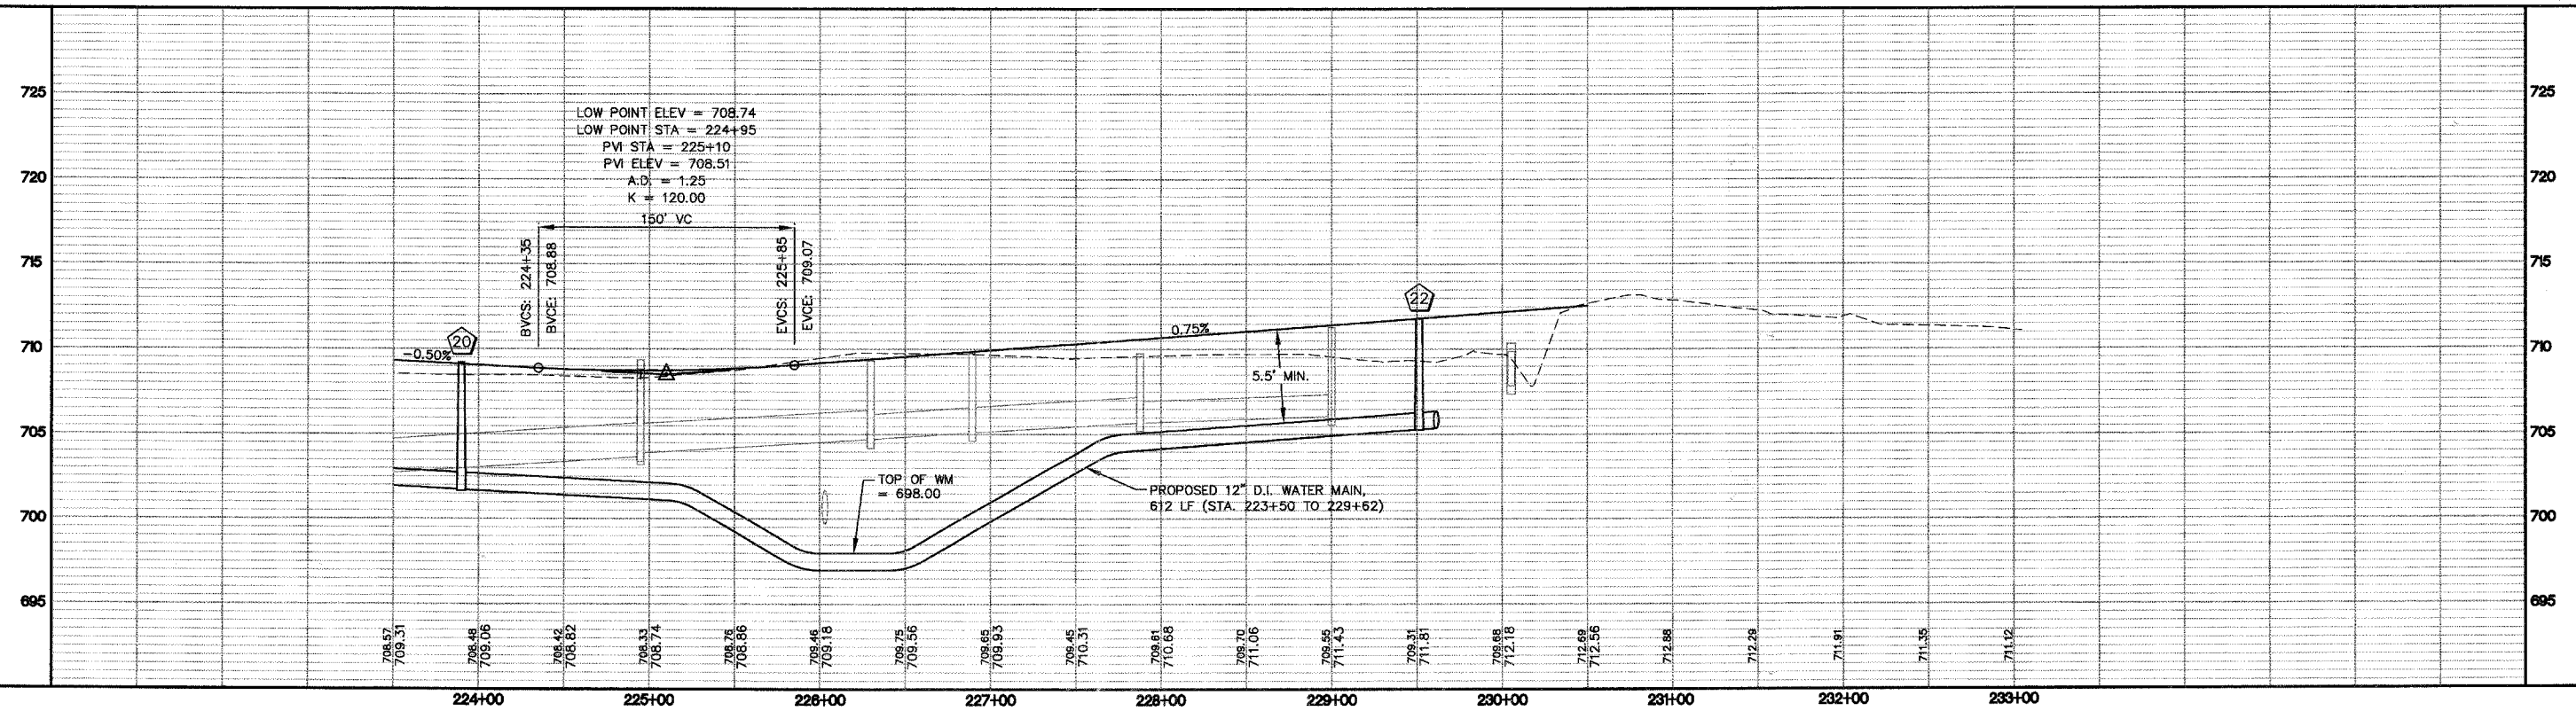

GALENA BOULEVARD WATER MAIN & SANITARY SEWER PLAN