


STATE OF ILLINOIS  
DEPARTMENT OF TRANSPORTATION

ROUTE NO.	SECTION	COUNTY	SHEET	SHEET	SHEET NO.
FAP 869	105BR-2	SALINE	118	51	23 SHEETS
FED. ROAD DIST. NO. 1		ILLINOIS	FED. AID PROJECT - RD		
78031					

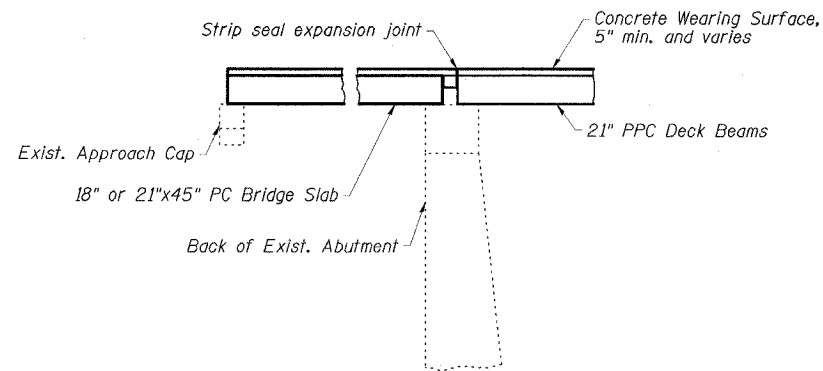

SECTION THRU ABUTMENTS  
@ OUTSIDE BEAM


GENERAL NOTES

1. Reinforcement bars shall conform to the requirements of ASTM A706 Gr 60 (IL Modified). See Special Provisions.
2. Plan dimensions and details relative to existing plans are subject to routine variations. The Contractor shall field verify existing dimensions and details affecting new construction and make necessary approved adjustments prior to construction or ordering of materials. Such variations shall not be cause for additional compensation for a change in scope of the work. However, the Contractor will be paid for the quantity actually furnished based upon the unit price bid for the work.
3. Concrete Sealer shall be applied to bearing seats where Structural Repair of Concrete is performed and also to the front face of the new concrete backwalls.
4. All new structural steel shall be shop painted with an inorganic zinc rich primer per AASHTO M300 Type 1 unless noted otherwise.
5. Side Retainers shall be AASHTO M270 Grade 36 minimum.
6. No in-stream work will be allowed on this project.
7. The Contractor is advised that the existing PPC Deck Beams are in a deteriorated condition with reduced load carrying capacity. It is the Contractor's responsibility to account for the condition of the beams when developing construction procedures for removal and replacement of the superstructure.
8. If the Contractor's procedures for existing beam removal or placement of new beams involves placement of heavy equipment on the new or existing deck beams, a detailed procedure shall be submitted to the Engineer for approval. The procedure shall include calculations, sealed by an Illinois Licensed Structural Engineer, verifying the structural adequacy of the beams for the proposed loads. Cost included with Precast Prestressed Concrete Deck Beams.

9. The minimum thickness of the concrete overlay shall be 5" and varies as required to adjust for the new profile grade and beam camber. Modify to meet field conditions as directed by the Engineer.
10. Repair of the substructure and removal of the existing expansion joints shall be completed prior to placement of the new deck beams. The cost of removing the existing expansion joints is included in Concrete Removal.
11. The existing expansion bearing pads contain asbestos. See Special Provisions for Asbestos Bearing Pad Removal.

TOTAL BILL OF MATERIAL

ITEM	UNIT	SUPER	SUB	TOTAL
Removal of Existing Superstructures No. 2	Each	1	-	1
Bridge Deck Grooving	Sq. Yd.	595	-	595
Protective Coat	Sq. Yd.	641	-	641
Precast Concrete Bridge Slab	Sq. Ft.	420	-	420
Precast Prestressed Concrete Deck Beams (21" Depth)	Sq. Ft.	2848	-	2848
Precast Prestressed Concrete Deck Beams (27" Depth)	Sq. Ft.	2076	-	2076
Reinforcement Bars, Epoxy Coated	Pound	8020	260	8280
Bar Splicers	Each	155	4	159
Steel Railing, Type SM	Foot	418	-	418
Name Plates	Each	1	-	1
Preformed Joint Strip Seal	Foot	135	-	135
Concrete Sealer	Sq. Ft.	-	142	142
Epoxy Crack Injection	Foot	-	302	302
Structural Repair of Concrete (Depth Equal to or Less Than 5")	Sq. Ft.	-	89	89
Asbestos Bearing Pad Removal	Each	-	66	66
Concrete Wearing Surface, 5"	Sq. Yd.	641	-	641
Concrete Removal	Sq. Yd.	-	2.2	2.2
Concrete Structures	Sq. Yd.	-	2.2	2.2
Removal of Existing Precast Concrete Units	Sq. Ft.	420	-	420

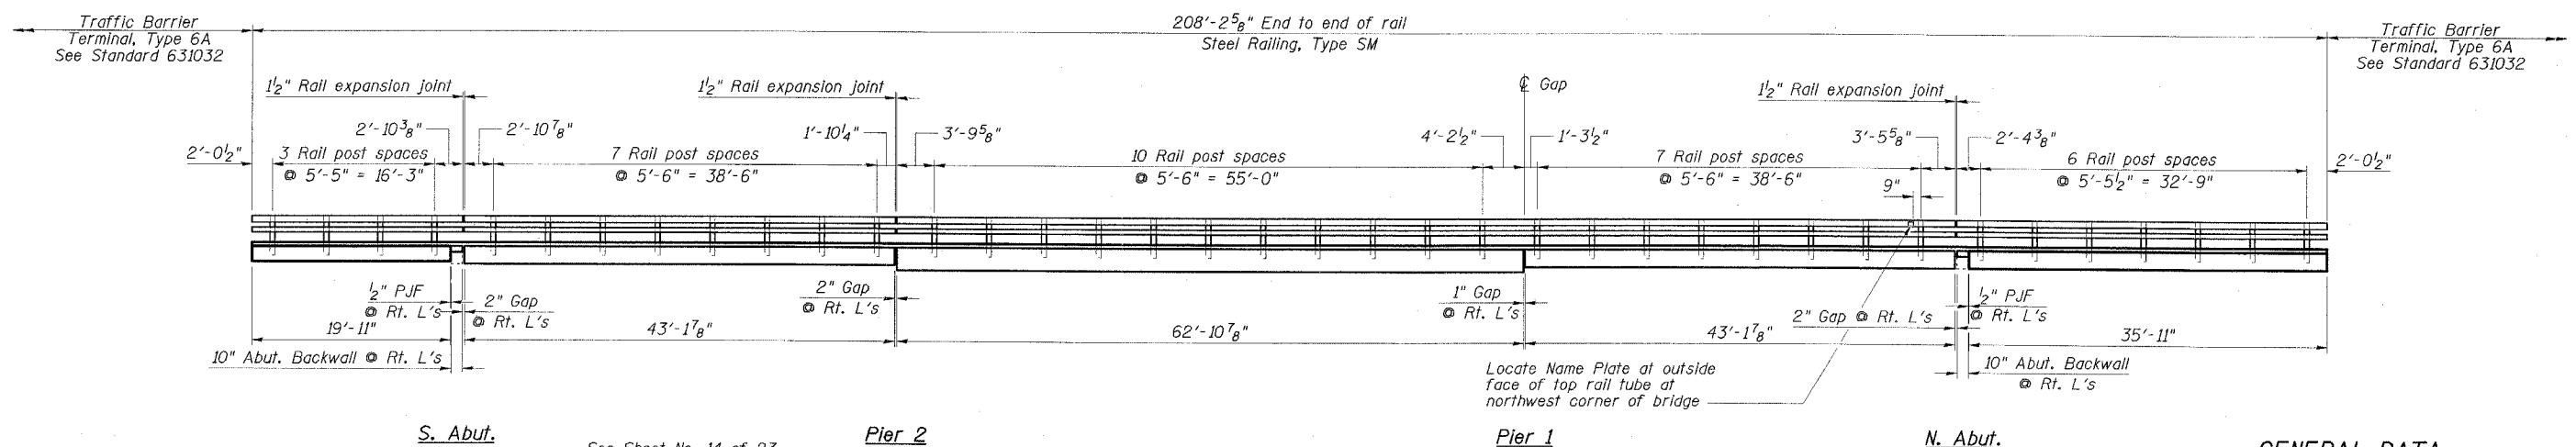

RAILING ELEVATION  
(Showing inside face of west railing;  
east railing similar)

GENERAL DATA  
IL 34 OVER  
MIDDLE FORK SALINE RIVER  
FAP ROUTE 869 - SECTION 105BR-2  
SALINE COUNTY  
STATION 1561+70.00  
STRUCTURE NO. 083-0038

**ESCA**  
CONSULTANTS, INC.

DESIGNED BY:	JMS	02/08
DRAWN BY:	HAS	02/08
CHECKED BY:	ELH	02/08
APPROVED BY:	RDP	02/08