


Bose_Vault

UN053

| REVISIONS | | |
|-----------|----|------|
| NUMBER | BY | DATE |
| | | |
| | | |
| | | |

0 1 2
 THIS BAR IS EQUAL TO 2"
 AT FULL SCALE (34X22).

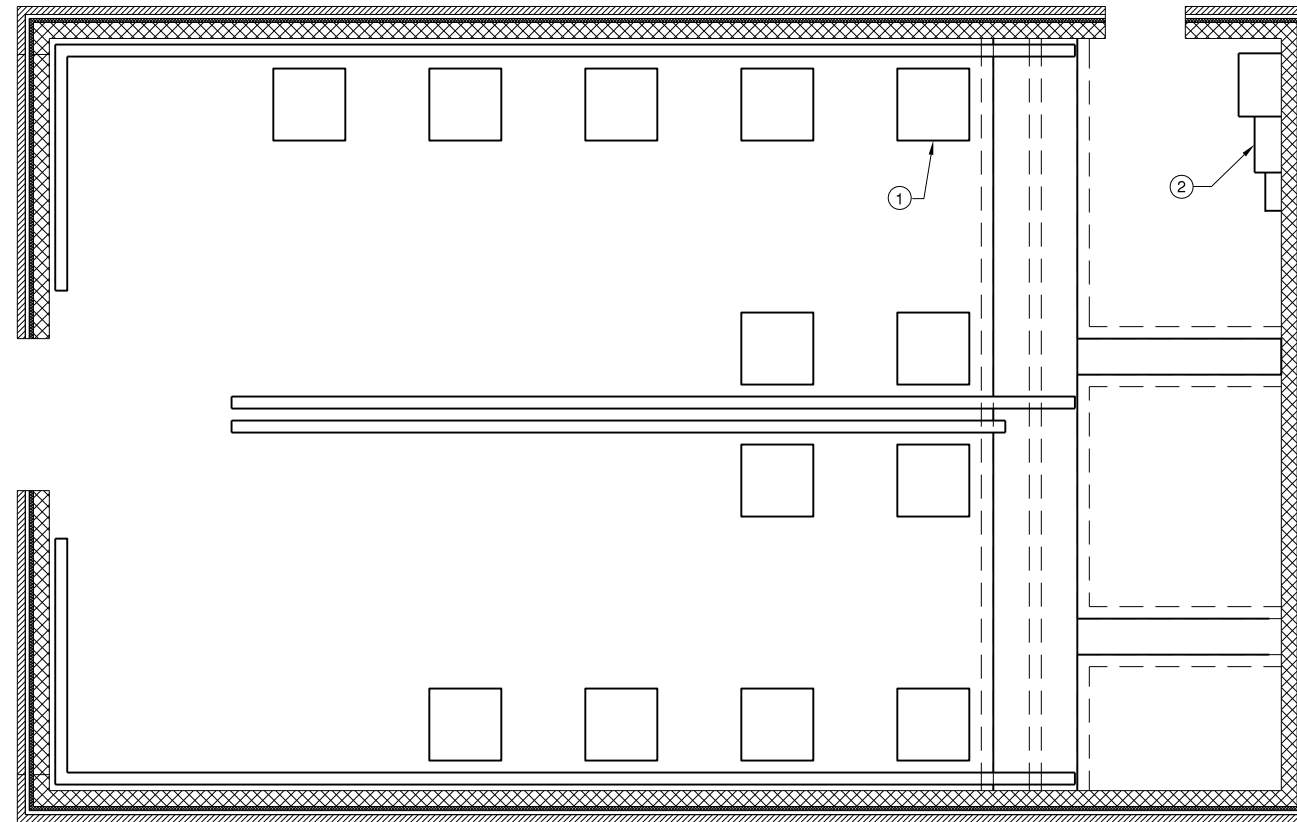

EXISTING VAULT PLAN

N.T.S.

EXISTING VAULT PLAN NOTES


- ① EXISTING RUNWAY 18/36 REGULATOR, L-829, 10 KW, 480V INPUT, 3-STEP 6.6A OUTPUT. REMOVE EXISTING NAMEPLATE AND REPLACE WITH ENGRAVED NAMEPLATE MATCHING EXISTING, WHICH READS "SPARE #7".
- ② EXISTING DISTRIBUTION PANEL #1, SECTION #1. TURN OFF CIRCUIT BREAKER FOR RUNWAY 18/36. REVISE ALL PANELBOARD SCHEDULES AND LEGEND PLATES TO READ "SPARE #7".

NOTES

- A. EXISTING POWER AND CONTROL WIRING TO EXISTING RUNWAY 18/36 REGULATOR SHALL REMAIN.

UNIVERSITY OF ILLINOIS
 WILLARD AIRPORT
 SAVOY, ILLINOIS

BASE BID - REALIGN AND WIDEN TAXIWAY C
 ELECTRICAL VAULT PLAN

© Copyright CMT, Inc.

CMT
 CRAWFORD, MURPHY & TILLY, INC.
 CONSULTING ENGINEERS
 License No. 184-000613

DESIGN BY: CBG

DRAWN BY: ADD

CHECKED BY: CET

APPROVED BY: CET

DATE: JUNE 27, 2014

JOB No: 13059-02-00

IL PROJ. NO. CMI-4347

AIP PROJ. NO. 3-17-0016-XX

SHEET 53 OF 83 SHEETS