



**1**  
**16** STAKE MOUNTED MEDIUM INTENSITY TAXIWAY LIGHT  
SCALE: 3/4" = 1'-0"

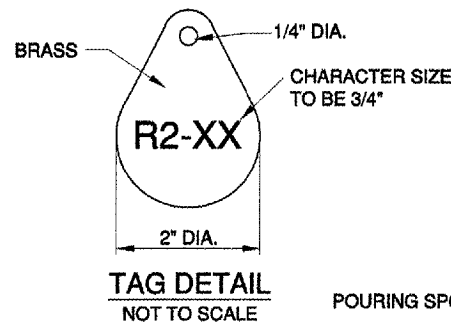

**2**  
**16** CABLE IN UNIT DUCT DETAIL  
N.T.S.

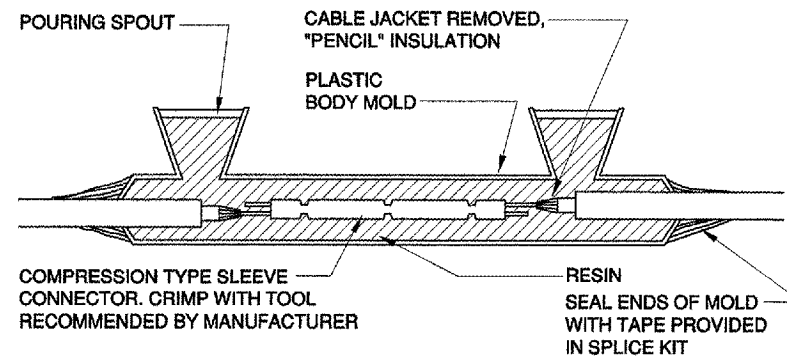


**TYPE A:**

FOR IN-LINE CONNECTIONS OF EXISTING CABLES CUT DURING CONSTRUCTION

**NOTES:**

1. INSIDE DIAMETER OF CONNECTOR SHALL PROPERLY MATCH THE OUTSIDE DIAMETER OF CABLE
2. THE COST OF FURNISHING AND INSTALLING ALL SPLICE MATERIALS SHALL BE INCIDENTAL TO THE ASSOCIATED CABLE ITEMS
3. THE CONTRACTOR SHALL HAVE A MINIMUM OF TWO (2) TYPE A SPLICE KITS ON THE JOB SITE AT ALL TIMES FOR EMERGENCY REPAIRS

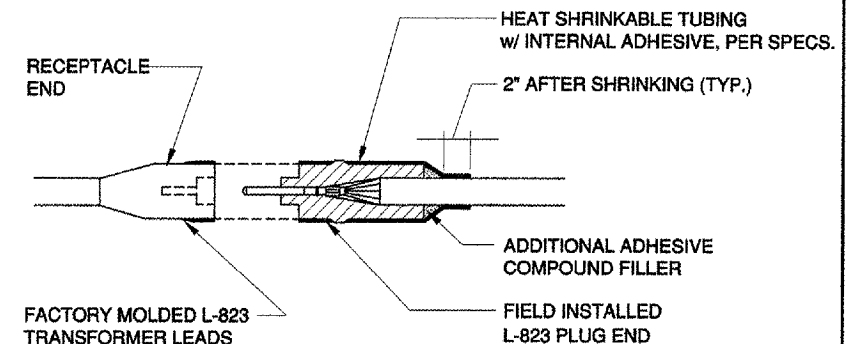

**TYPE C & D:**

FOR SPLICES AT TAXIWAY LIGHTS AND SIGNS

**3**  
**16** CABLE SPLICES  
N. T. S.