
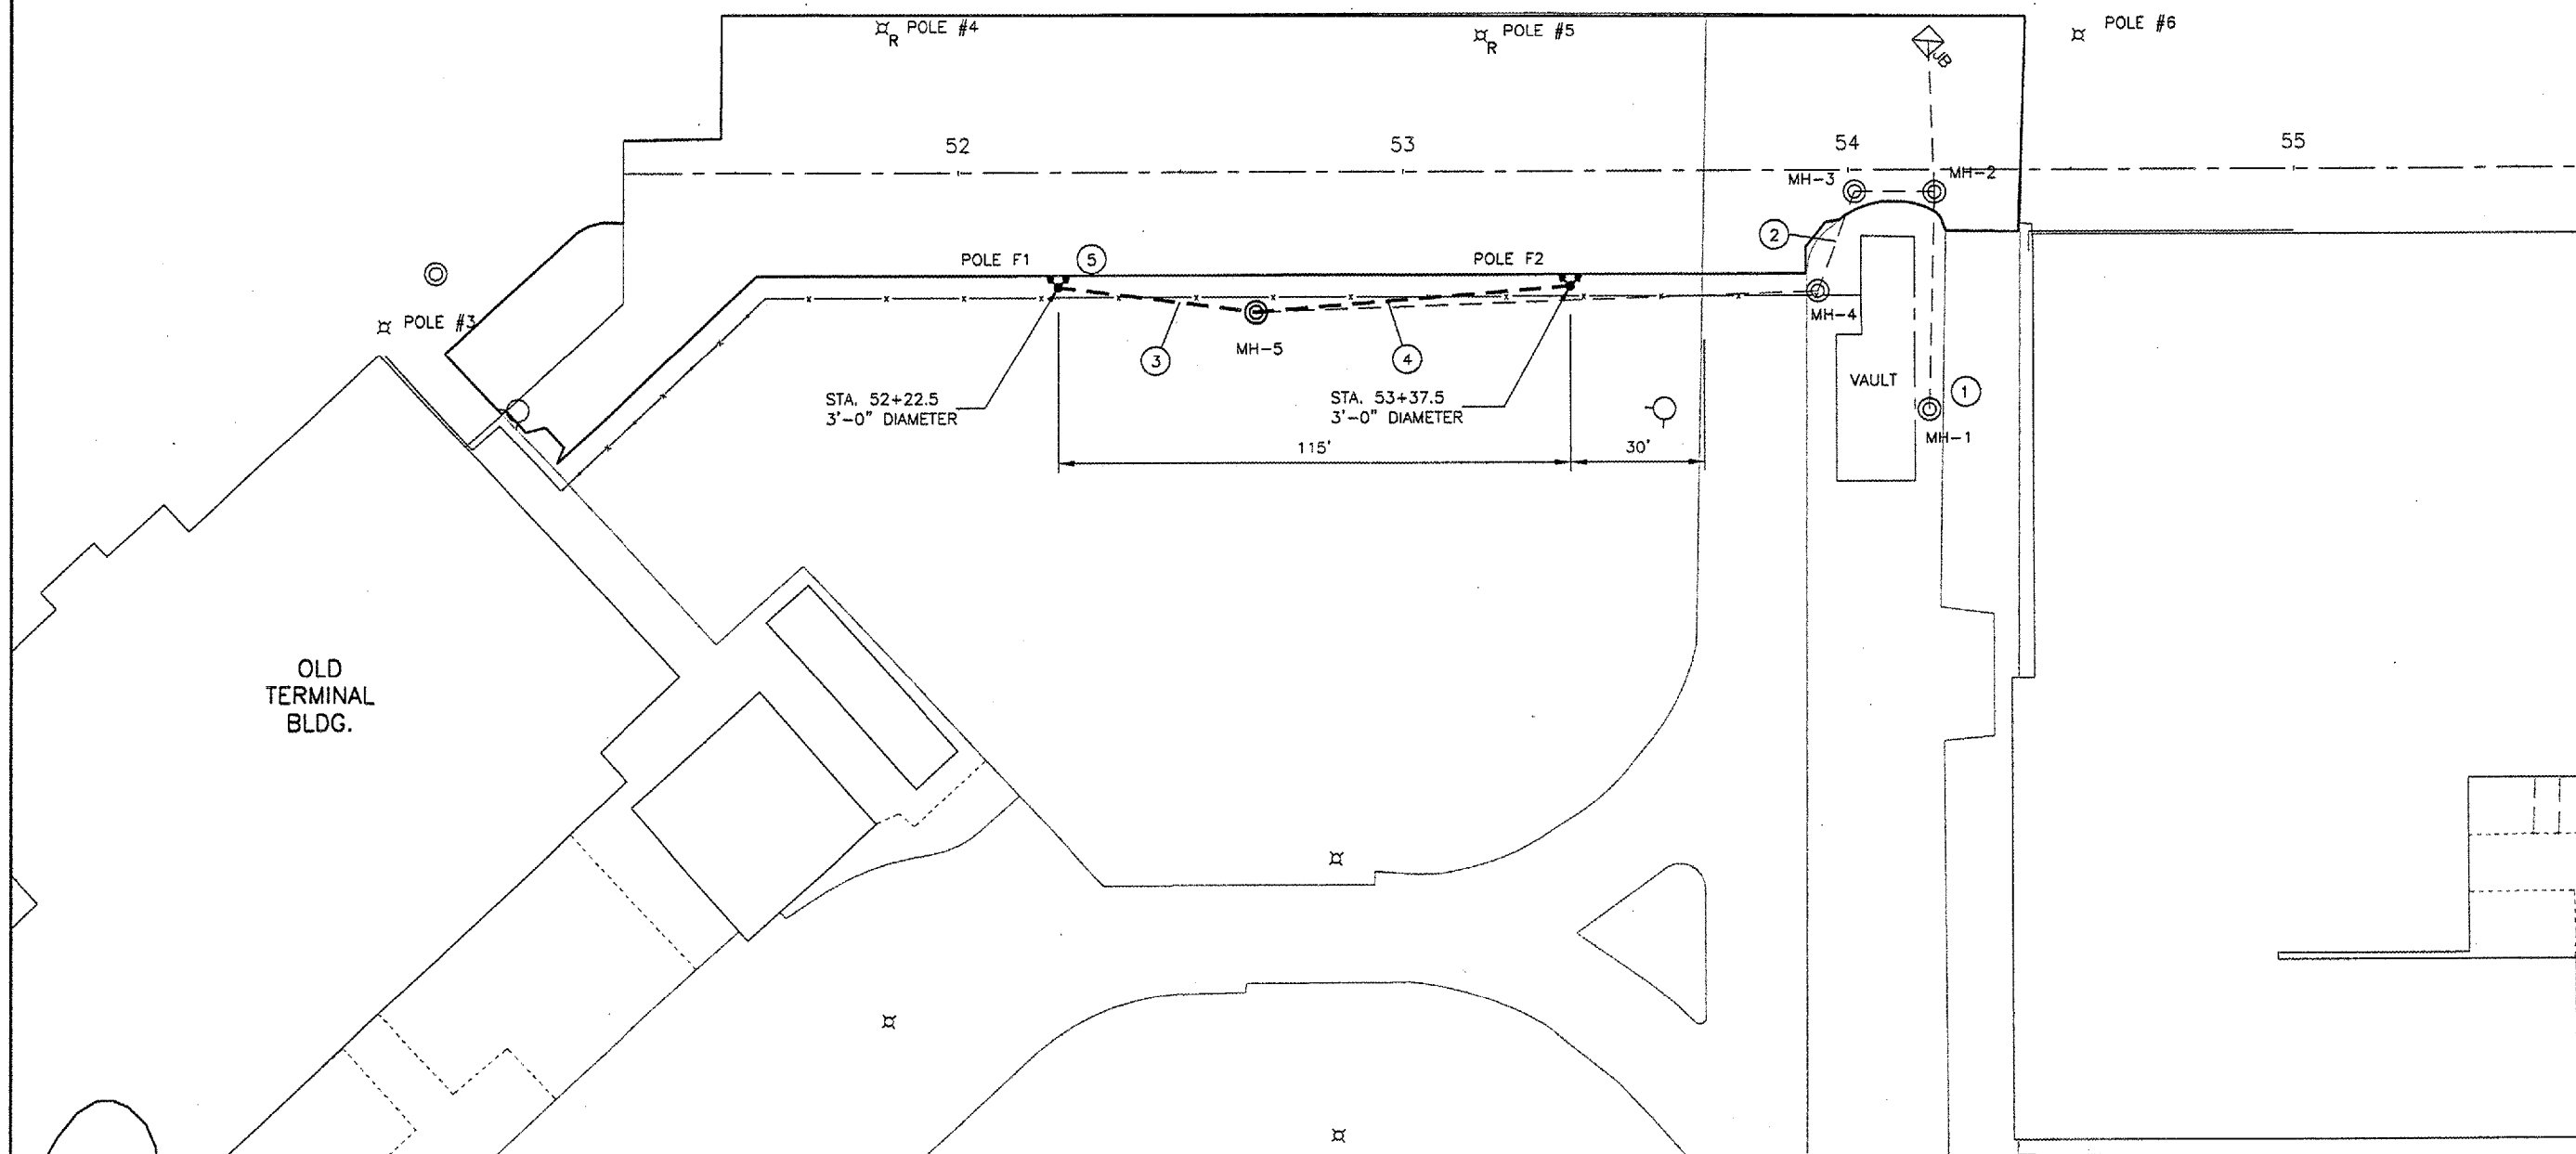


- NOTES:**
- ① AT MH-1 SPLICE INTO CIRCUIT FEEDING POLES #4, #5 AND #6. CIRCUIT MUST REMAIN INTACT TO FEED POLE #6.
 - ② INSTALL 3-1/C #8 600V, 1-1/C #8 GND IN SPARE DUCT FROM MH #1 TO MH #5.
 - ③ INSTALL 6-1/C #8 600V, 2-1/C #8 GND IN 2" PVC CONCRETE ENCASED DUCT BANK.
 - ④ INSTALL 3-1/C #8 600V, 1-1/C #8 GND IN 2" PVC CONCRETE ENCASED DUCT BANK.
 - ⑤ PLACE LIGHT POLES 3'-0" FROM FENCE LINE AT CENTER.

LEGEND

- EXISTING LIGHT POLE AND FOUNDATION TO BE REMOVED
- NEW LIGHT POLE AND FOUNDATION, 2 FIXTURES
- EXISTING DUCT BANK
- NEW DUCT BANK
- EXISTING HANDHOLE
- EXISTING MANHOLE

REVISIONS		
NUMBER	BY	DATE



**WILLARD AIRPORT
 UNIVERSITY OF ILLINOIS
 REHABILITATE GA/SCHOOL APRON
 APRON LIGHT LAYOUT**

© Copyright CMT, Inc.
CMT
 CRANFORD, MERRIN & TILLY, INC.
 CONSULTING ENGINEERS
 License No. 04-000613

DESIGN BY:	JEF
DRAWN BY:	CMT
CHECKED BY:	SMH
APPROVED BY:	JEF
DATE:	06/09/2006
JOB No:	0605902
IL PROJ. NO.	CMI-3589
AIP PROJ. NO.	3-17-00XX-XX
SHEET 11 OF 16 SHEETS	