


F.A.I. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
90/94	2004-068L	COOK	37	30
STA.	TO STA.			
FED. ROAD DIST. NO. 1 ILLINOIS FED. AID PROJECT				
62807				

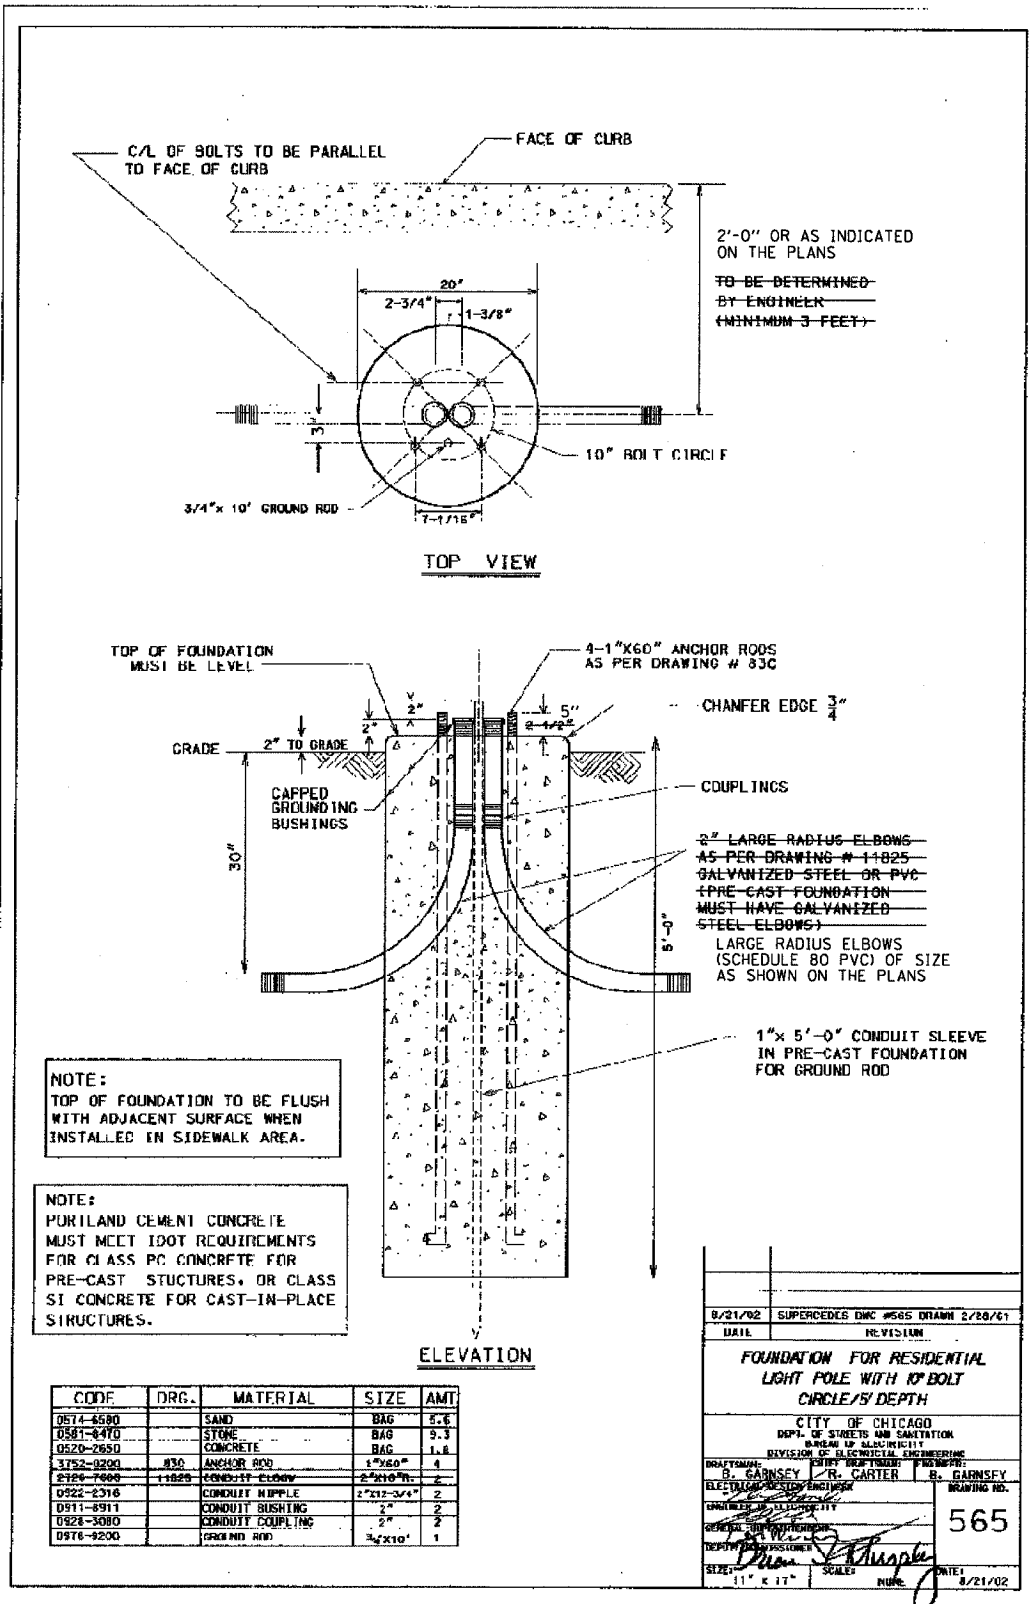


NOTE:  
TOP OF FOUNDATION TO BE FLUSH WITH ADJACENT SURFACE WHEN INSTALLED IN SIDEWALK AREA.

NOTE:  
PORTLAND CEMENT CONCRETE MUST MEET IDOT REQUIREMENTS FOR CLASS PC CONCRETE FOR PRE-CAST STRUCTURES, OR CLASS SI CONCRETE FOR CAST-IN-PLACE STRUCTURES.

CODE	DRG.	MATERIAL	SIZE	AMT
0514-6580		SAND	BAG	676
0521-8470		STONE	BAG	531
0520-2650		CONCRETE	BAG	1.8
3752-9200	830	ANCHOR ROD	1"x60"	4
2929-7600	11825	CONDUIT ELBOW	2"x10"	2
0922-2316		CONDUIT NIPPLE	2"x12-3/4"	2
0911-8911		CONDUIT BUSHING	2"	2
0928-3080		CONDUIT COUPLING	2"	2
0976-9200		GROUND ROD	3/4"x10"	1

8/21/02	SUPERCEDES DMC #565 DRAWN 2/28/01	REVISION
FOUNDATION FOR RESIDENTIAL LIGHT POLE WITH 10" BOLT CIRCLE/5' DEPTH		
CITY OF CHICAGO DEPT. OF STREETS & SANITATION DIVISION OF ELECTRICAL ENGINEERING		
DRAWN BY	CHECKED BY	ENGINEER
B. GARNSEY	R. CARTER	B. GARNSEY
PROJECT NO. 565		DWG. NO. 579
DATE	SCALE	DATE
8/21/02	11" x 17"	7-14-02

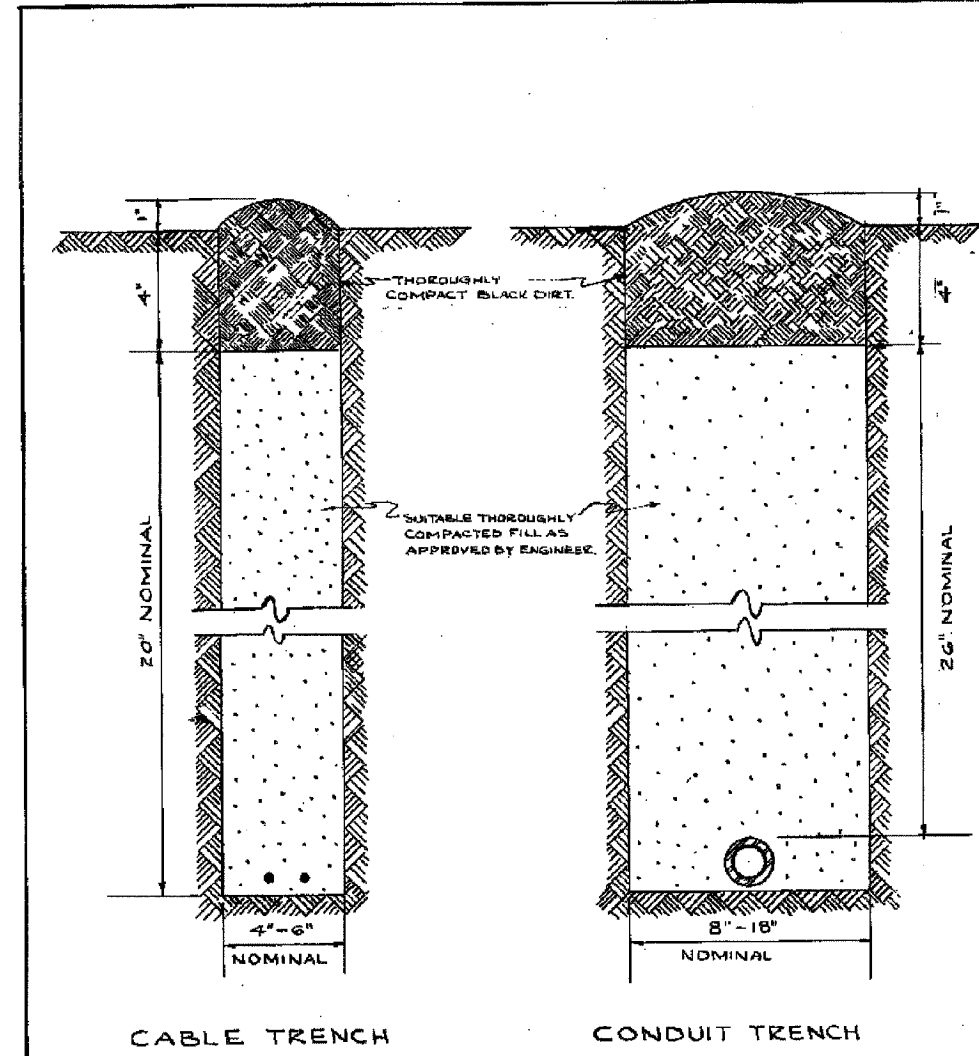

NOTE:  
EXCESS SOIL FROM TRENCH TO BE COMPLETELY REMOVED FROM SITE AS SOON AS PRACTICABLE.  
BLACK DIET TO BE TAMPED & THOROUGHLY COMPACTED AS SHOWN.

STANDARD METHOD FOR BACKFILLING CABLE & CONDUIT TRENCHES IN SODDED PARKWAY & LAWNS			
REVISION	CITY OF CHICAGO DEPT. OF STREETS & SANITATION DIVISION OF ELECTRICAL ENGINEERING		
A	DRAWN BY	CHECKED BY	ENGINEER
B	W. E. HARR	M. J. HARR	J. O'CONNOR
C	ENGINE IN CHARGE		
D	SUFF. OF CONET		
E	DATE 7-14-02		
F	SCALE 1/4" = 1'-0"		
G	DATE 7-14-02		
H	DATE 7-14-02		

NOTES:  
1. BOE STANDARD 565 MODIFIED BY CTE. THE INSTALLATION OF FOUNDATION FOR RESIDENTIAL LIGHT POLE WITH 10" BOLT CIRCLE / 5' DEPTH SHALL BE COORDINATED WITH AND APPROVED BY THE ENGINEER PRIOR TO BEGINNING WORK.

02/02/2005 09:09:46 AM