


QUANTITIES - REMOVAL				
ITEM No.	DESCRIPTION	UNIT	QUANTITY	AS BUILT QUANTITY
AR125901	REMOVE STAKE MOUNTED LIGHT	EACH	91	
AR125902	REMOVE BASE MOUNTED LIGHT	EACH	12	
AR125904	REMOVE TAXI GUIDANCE SIGN	EACH	7	

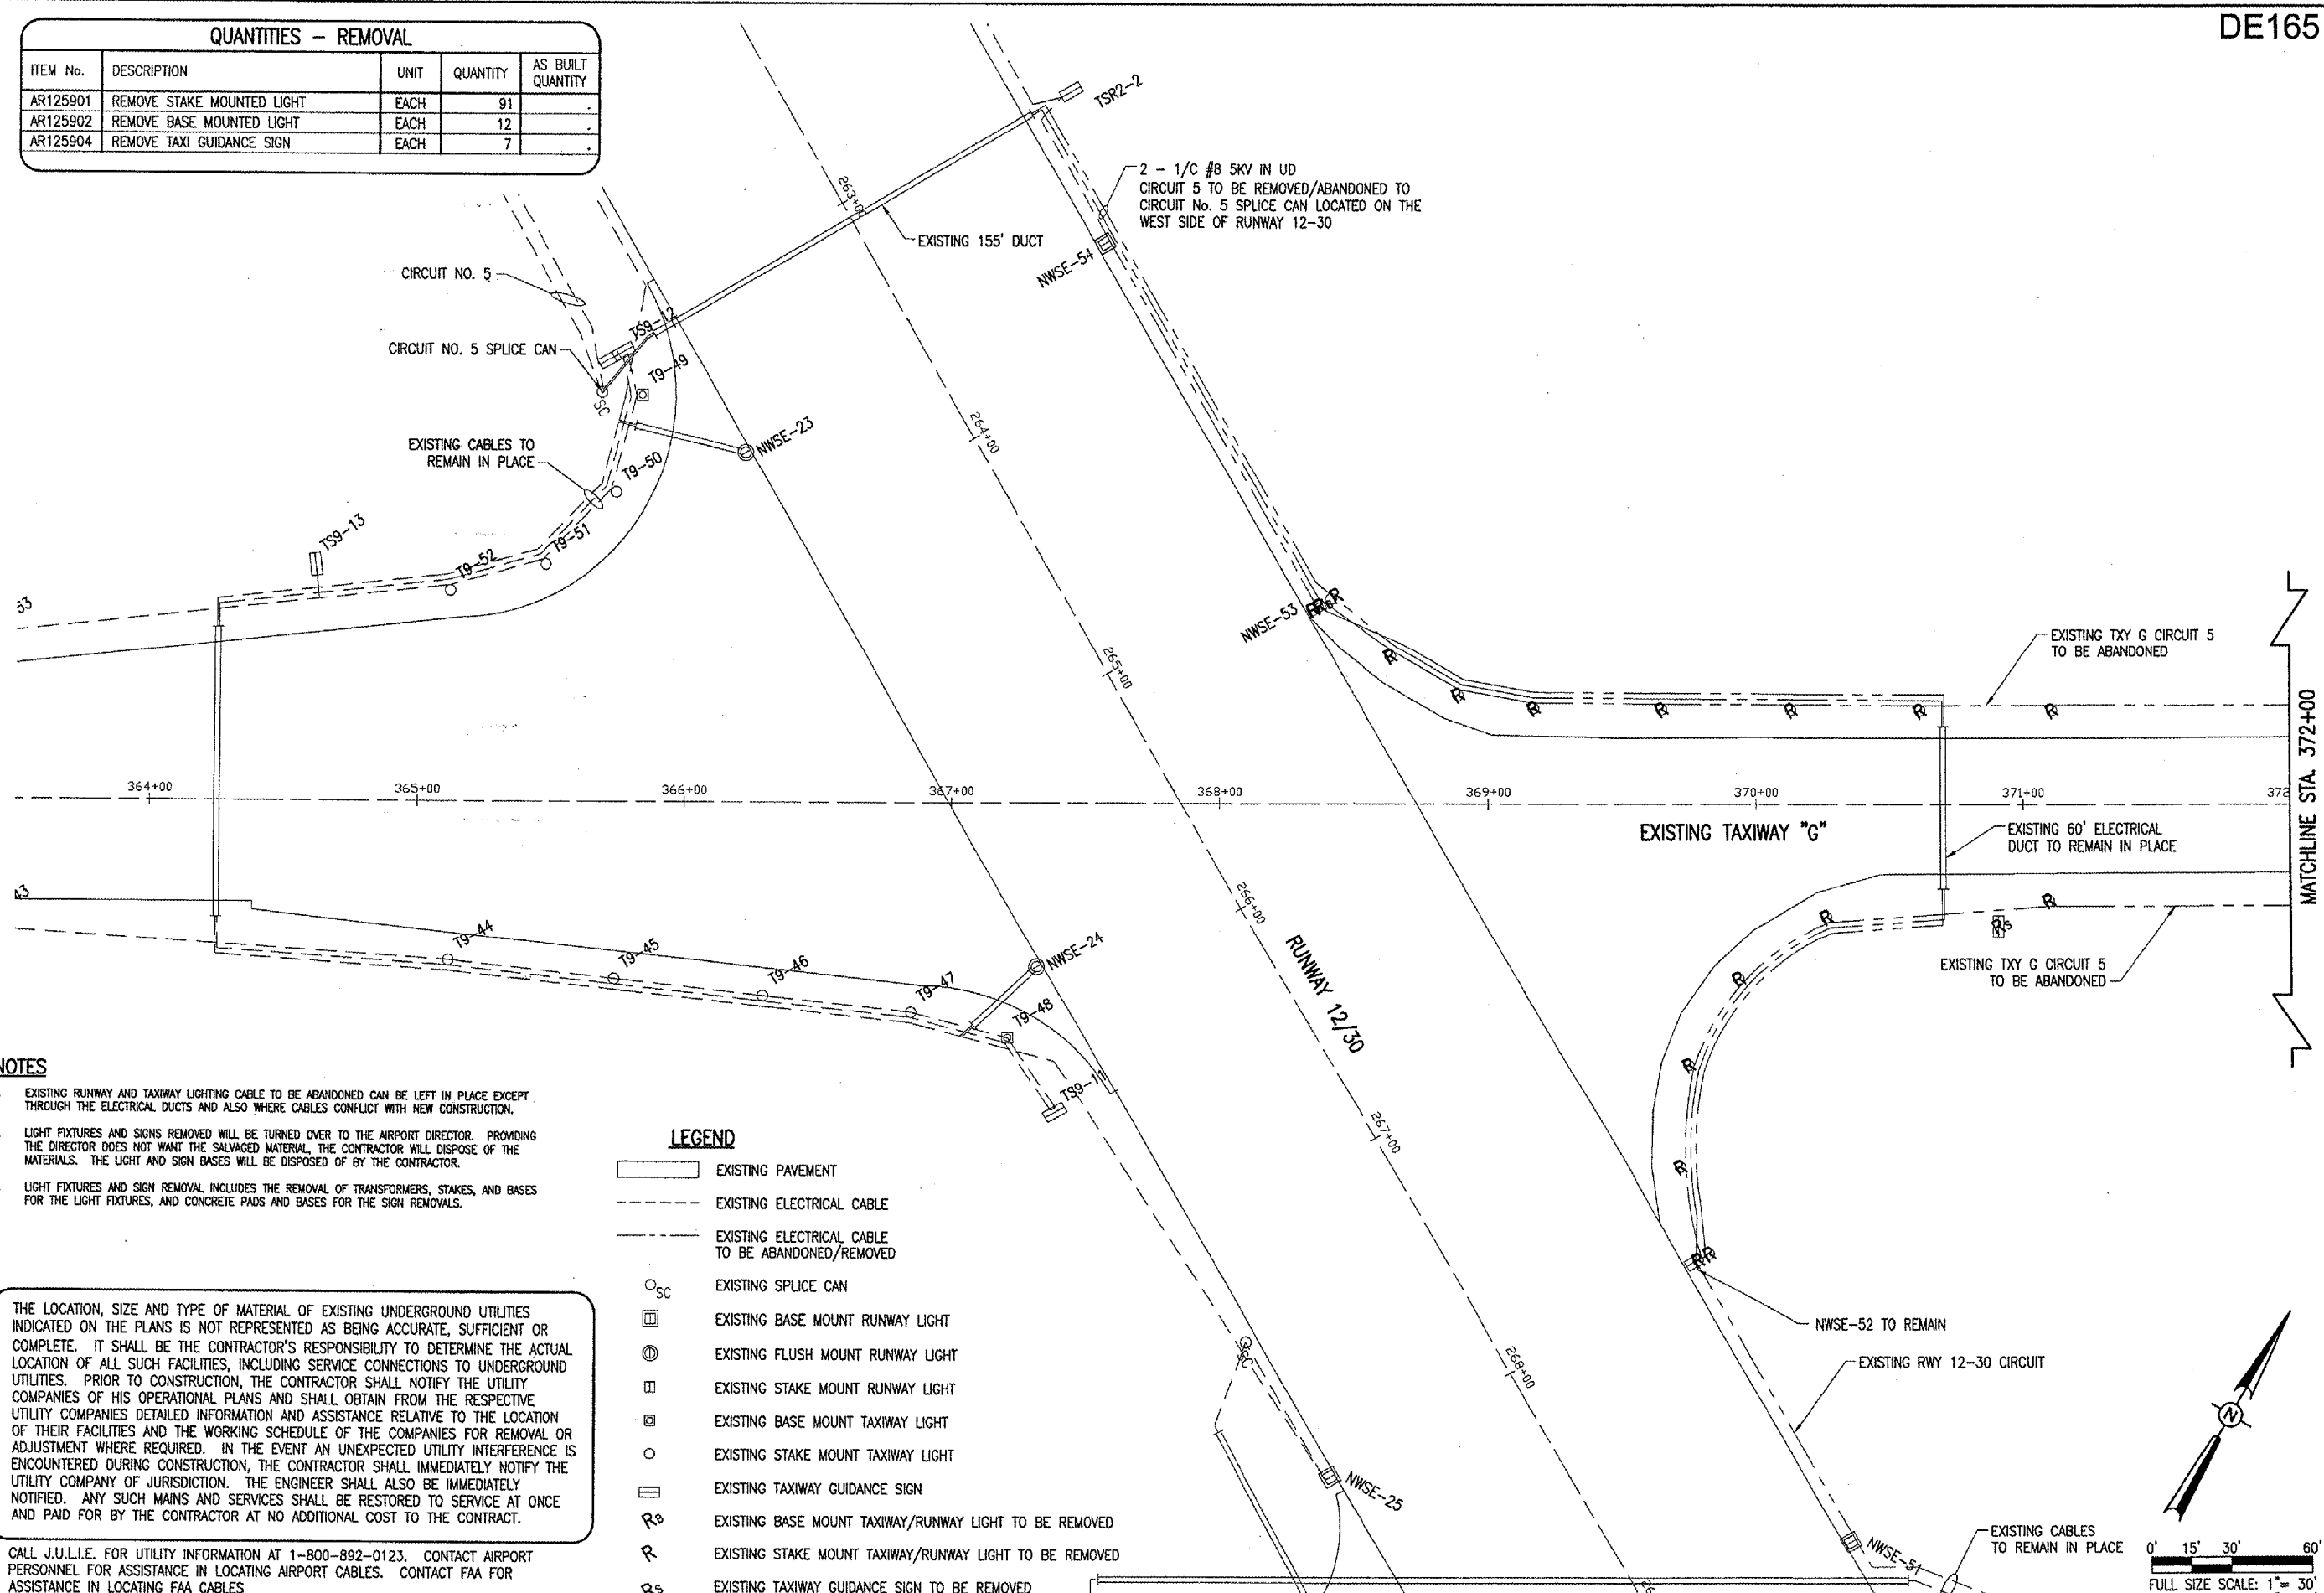


- NOTES**
- EXISTING RUNWAY AND TAXIWAY LIGHTING CABLE TO BE ABANDONED CAN BE LEFT IN PLACE EXCEPT THROUGH THE ELECTRICAL DUCTS AND ALSO WHERE CABLES CONFLICT WITH NEW CONSTRUCTION.
 - LIGHT FIXTURES AND SIGNS REMOVED WILL BE TURNED OVER TO THE AIRPORT DIRECTOR. PROVIDING THE DIRECTOR DOES NOT WANT THE SALVAGED MATERIAL, THE CONTRACTOR WILL DISPOSE OF THE MATERIALS. THE LIGHT AND SIGN BASES WILL BE DISPOSED OF BY THE CONTRACTOR.
 - LIGHT FIXTURES AND SIGN REMOVAL INCLUDES THE REMOVAL OF TRANSFORMERS, STAKES, AND BASES FOR THE LIGHT FIXTURES, AND CONCRETE PADS AND BASES FOR THE SIGN REMOVALS.

- LEGEND**
- EXISTING PAVEMENT
 - EXISTING ELECTRICAL CABLE
 - EXISTING ELECTRICAL CABLE TO BE ABANDONED/REMOVED
 - EXISTING SPLICE CAN
 - EXISTING BASE MOUNT RUNWAY LIGHT
 - EXISTING FLUSH MOUNT RUNWAY LIGHT
 - EXISTING STAKE MOUNT RUNWAY LIGHT
 - EXISTING BASE MOUNT TAXIWAY LIGHT
 - EXISTING STAKE MOUNT TAXIWAY LIGHT
 - EXISTING TAXIWAY GUIDANCE SIGN
 - EXISTING BASE MOUNT TAXIWAY/RUNWAY LIGHT TO BE REMOVED
 - EXISTING STAKE MOUNT TAXIWAY/RUNWAY LIGHT TO BE REMOVED
 - EXISTING TAXIWAY GUIDANCE SIGN TO BE REMOVED

THE LOCATION, SIZE AND TYPE OF MATERIAL OF EXISTING UNDERGROUND UTILITIES INDICATED ON THE PLANS IS NOT REPRESENTED AS BEING ACCURATE, SUFFICIENT OR COMPLETE. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE ACTUAL LOCATION OF ALL SUCH FACILITIES, INCLUDING SERVICE CONNECTIONS TO UNDERGROUND UTILITIES. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL NOTIFY THE UTILITY COMPANIES OF HIS OPERATIONAL PLANS AND SHALL OBTAIN FROM THE RESPECTIVE UTILITY COMPANIES DETAILED INFORMATION AND ASSISTANCE RELATIVE TO THE LOCATION OF THEIR FACILITIES AND THE WORKING SCHEDULE OF THE COMPANIES FOR REMOVAL OR ADJUSTMENT WHERE REQUIRED. IN THE EVENT AN UNEXPECTED UTILITY INTERFERENCE IS ENCOUNTERED DURING CONSTRUCTION, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE UTILITY COMPANY OF JURISDICTION. THE ENGINEER SHALL ALSO BE IMMEDIATELY NOTIFIED. ANY SUCH MAINS AND SERVICES SHALL BE RESTORED TO SERVICE AT ONCE AND PAID FOR BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE CONTRACT.

CALL J.U.L.I.E. FOR UTILITY INFORMATION AT 1-800-892-0123. CONTACT AIRPORT PERSONNEL FOR ASSISTANCE IN LOCATING AIRPORT CABLES. CONTACT FAA FOR ASSISTANCE IN LOCATING FAA CABLES

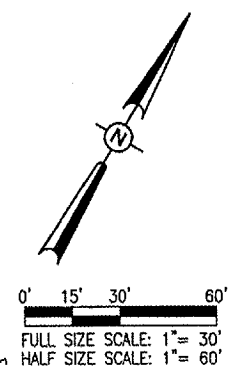

DATE	REVISION	BY

DECATUR AIRPORT
DECATUR, ILLINOIS
 IL. PROJ.: DEC-3414
 A.I.P. PROJ.: 3-17-00333-28

REV.	DATE	BY	DESCRIPTION
03/17/05	CCC	CCC	LAYOUT
03/17/05	CCC	CCC	DRAWN
06/07/05	NUM	NUM	REVIEWED

HANSON
 Engineers, Architects, Scientists
 1525 South Sixth Street
 Springfield, Illinois 62703-2886
 Offices Nationwide

**TAXIWAY G WIDENING
 PHASE II**
 EXISTING ELECTRICAL
 REMOVAL PLAN
 STA. 367+85.60 TO STA. 372+00

JUN 10, 2005 9:31 AM CCC
 I:\AIRPORTS\DECATUR\802-04TXD\AIRPORT SHEETS\CONTRACT-1\141ELE.DWG - 367+85.60 TO 372