

RO011



Rockford, Illinois
Greater Rockford
Airport Authority

AIP: 3-17-0088-XX
RFD-3507

NW Air Cargo
Sitework
(Phase 2)

Revisions		
No.	Date	Description


DESIGN BY:	DLP
DRAWN BY:	CMT
CHECKED BY:	DLP
APPROVED BY:	DLP
DATE:	6.10.2005
JOB No:	05258-06-00

JOINTING DETAILS


12 (JDT1)

JOINT NOTES


- ALL EDGES OF NEW SLABS, FREE STANDING OR CLOSURE, SHALL BE EDGED WITH AN APPROVED TOOL HAVING A RADIUS OF 1/8" TO 1/4" TO FACILITATE SAWING OF THE SEALANT RESERVOIR. A RADIUS > 1/4" WILL NOT BE ACCEPTABLE.
- THE INITIAL SAWCUT FOR ALL LONGITUDINAL AND TRANSVERSE CONTRACTION JOINTS SHALL BE SAWS AS SOON AS POSSIBLE AFTER PLACEMENT OF THE PAVEMENT. SAWING OF LONGITUDINAL CONTRACTION JOINTS ADJACENT TO THE THICKENED EDGES SHALL BE GIVEN PRIORITY OVER OTHER LONGITUDINAL JOINT SAWING.
- ALL DOWEL BARS SHALL BE SECURELY HELD IN PLACE BY MEANS OF A DOWEL BAR ASSEMBLY OR MECHANICALLY INSTALLED PER ARTICLE 420.10 JOINTS OF THE ILLINOIS DEPARTMENT OF TRANSPORTATION "STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION" WHICH WILL INSURE THAT THEY WILL REMAIN PARALLEL TO THE PAVEMENT LANES. THE DOWEL BAR ASSEMBLIES OR MECHANICAL METHOD SHALL BE APPROVED BY THE ENGINEER PRIOR TO INSTALLATION.
- ALL TIE BARS AND MESH SHALL BE SECURELY HELD IN PLACE BY SUPPORT PINS OR PLACED BY OTHER APPROVED METHODS TO PREVENT SHIFTING DURING AND AFTER CONCRETE PLACEMENT.
- WHEN TIE BARS ARE USED FOR SLIP-FORM LONGITUDINAL CONTRACTION JOINTS, ONE END OF THE TIE BAR SHALL BE BENT AND INSERTED INTO THE KEYWAY OF THE JOINT. THE BENT BARS SHALL BE STRAIGHTENED TO RIGHT ANGLES WITH LONGITUDINAL JOINT AND SHALL EXTEND INTO THE ADJACENT LANE PARALLEL TO THE PAVEMENT SURFACE.
- METAL FORMS USED FOR KEYS JOINTS WILL BE REMOVED UNLESS OTHERWISE APPROVED BY THE ENGINEER.
- THE BARS SHALL BE DEFORMED BARS IN CONFORMANCE WITH ASTM A615 OR ASTM A616, EXCEPT THAT RAIL STEEL BARS, GRADE 50 OR 60 SHALL NOT BE USED FOR THE BARS THAT ARE TO BE BENT OR RESTRAIGHTEND DURING CONSTRUCTION. THE BARS DESIGNATED AS GRADE 40 IN ASTM A615 CAN BE USED FOR CONSTRUCTION REGARDING BENT BARS.
- THE INITIAL SAWCUT SHALL BE MADE TO THE 1/8" WIDTH INDICATED. INITIAL SAWING TO THE DIMENSION OF THE SECOND SAWCUT WILL NOT BE ALLOWED.
- JOINTS SHALL BE DRY AND CLEAN BEFORE SEALING OPERATIONS BEGIN.
- COST OF ALL JOINT SAWING, CLEANING AND SEALING OF NEW CONCRETE PAVEMENT SHALL BE CONSIDERED INCIDENTAL TO THE ASSOCIATED PAY ITEM AND NO SEPARATE PAYMENT SHALL BE MADE.
- SHOULD THE POURING OPERATIONS REQUIRE THE INSERTION OF AN INTERMEDIATE HEADER, A DOWEL BASKET ASSEMBLY OR OTHER APPROVED METHOD OF DOWEL BAR PLACEMENT SHALL BE REQUIRED.
- DOWEL BASKET ASSEMBLIES MEETING IDOT APPROVAL MAY BE PROPOSED BY THE CONTRACTOR TO BE APPROVED BY THE ENGINEER. DOWELS IN THE APPROVED BASKET ASSEMBLIES SHALL CONFORM TO TABLE 2.
- CONTRACTOR SHALL CONSTRUCT A 1/4" CHAMFER ON ALL CONCRETE JOINTS AT NO ADDITIONAL COST.

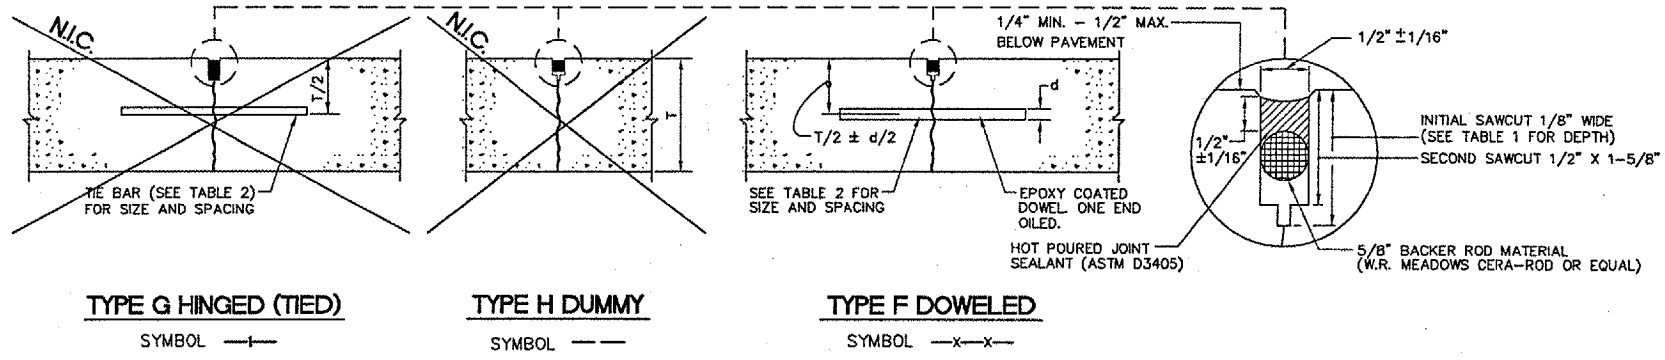


CONTRACTION JOINTS
 TYPE G HINGED (TIED) SYMBOL ———
 TYPE H DUMMY SYMBOL ———
 TYPE F DOWELED SYMBOL —x—x—

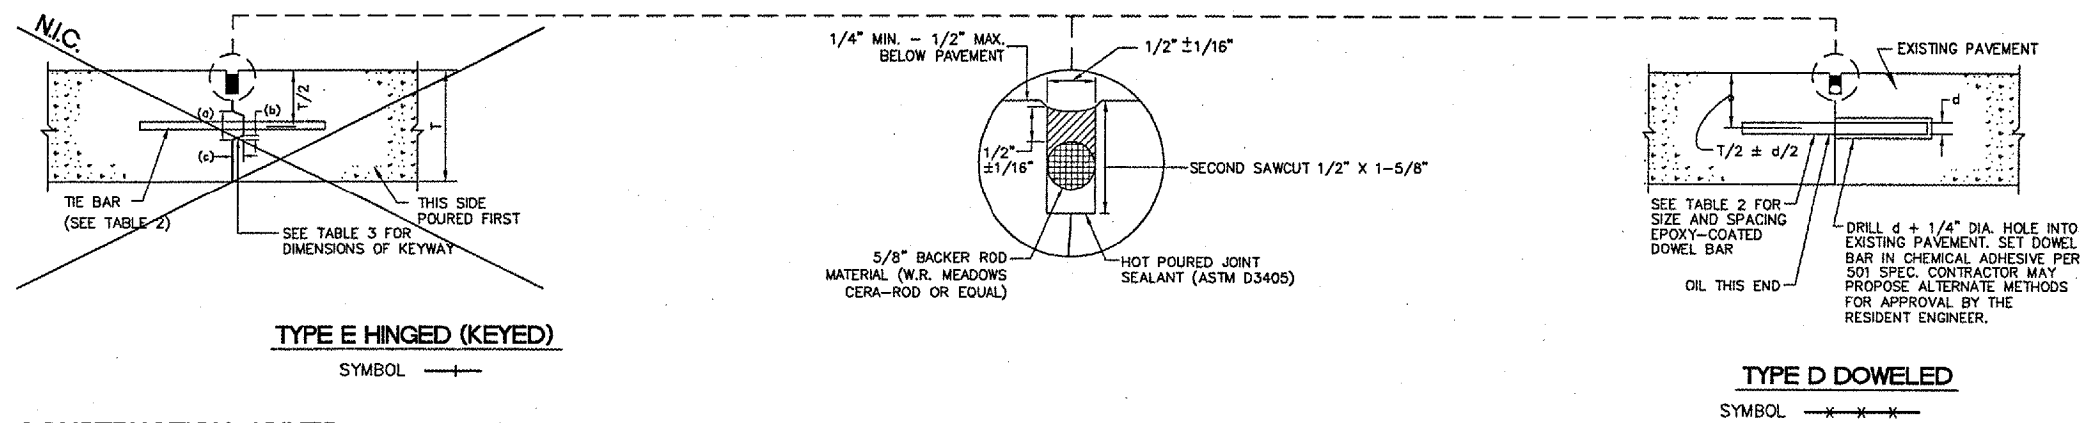


CONSTRUCTION JOINTS
 TYPE E HINGED (KEYED) SYMBOL ———
 TYPE D DOWELED SYMBOL —x—x—

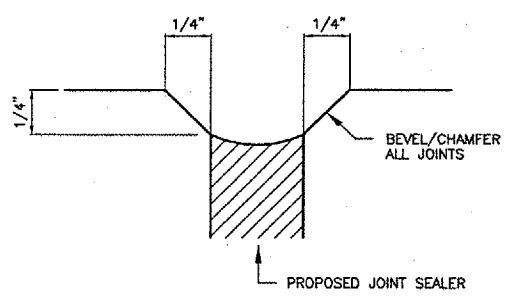


CHAMFER/BEVEL JOINT DETAIL
N.T.S.

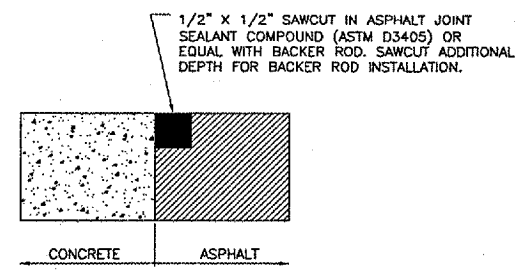


JOINT SEALING AT CONCRETE ASPHALT INTERFACE
N.T.S.
NOTE: JOINT DIMENSIONS SHALL MEET MANUFACTURER'S RECOMMENDATION

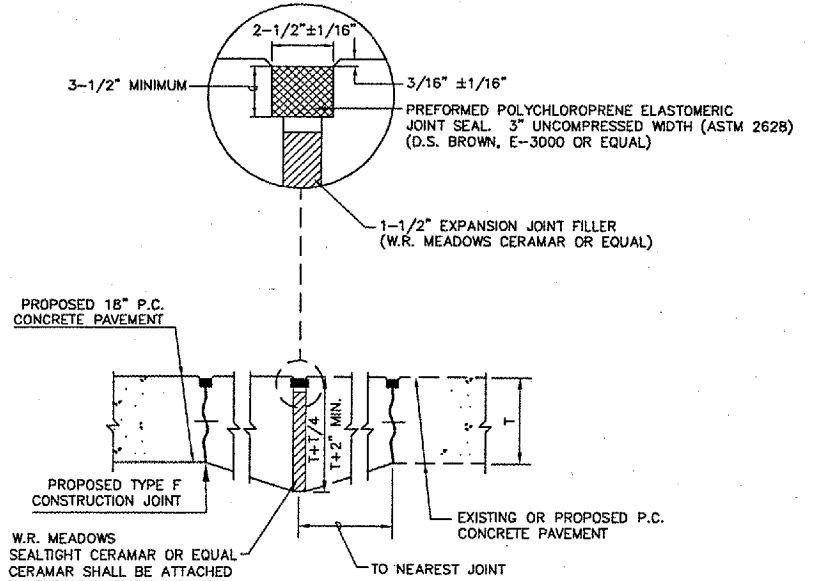

TYPE B EXPANSION
SYMBOL ———

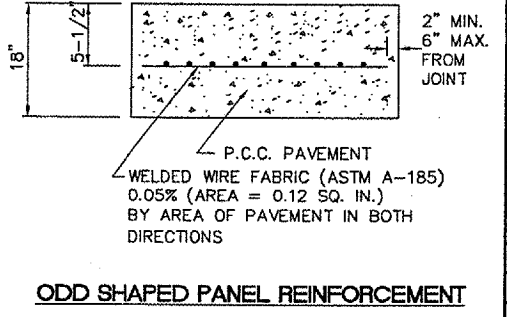

ODD SHAPED PANEL REINFORCEMENT

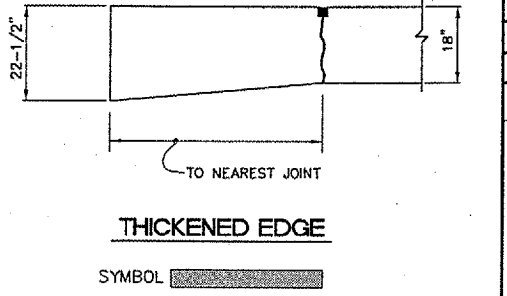

THICKENED EDGE
SYMBOL ———

TABLE 1

PAVEMENT THICKNESS T - INCHES	DEPTH OF CONTRACTION JOINT INITIAL SAW CUT T, INCHES T=(T/4) ±1/4"
18"	4.5"

TABLE 2

PAVEMENT THICKNESS T - INCHES	DOWEL BAR DETAILS			TIE BAR DETAILS		
	DIA. (d)	LENGTH	SPACING	BAR SIZE	LENGTH	SPACING
18"	1-1/2"	20"	18"	#5	30"	30"