

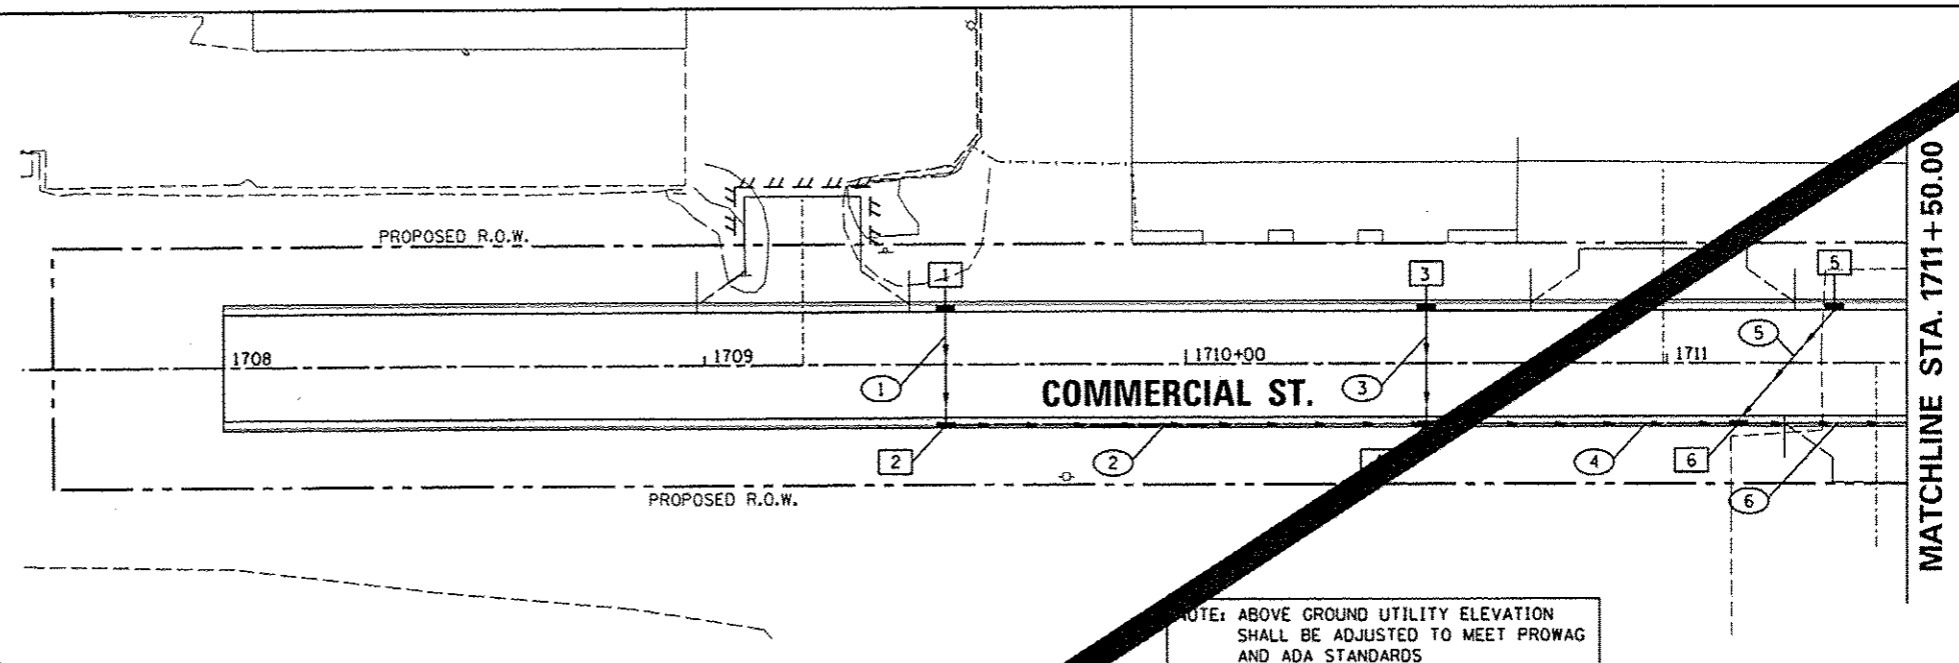


DATE: _____
 BY: _____
 CHECKED: _____
 DATE: _____
 NO. _____

DATE: _____
 BY: _____
 CHECKED: _____
 DATE: _____
 NO. _____

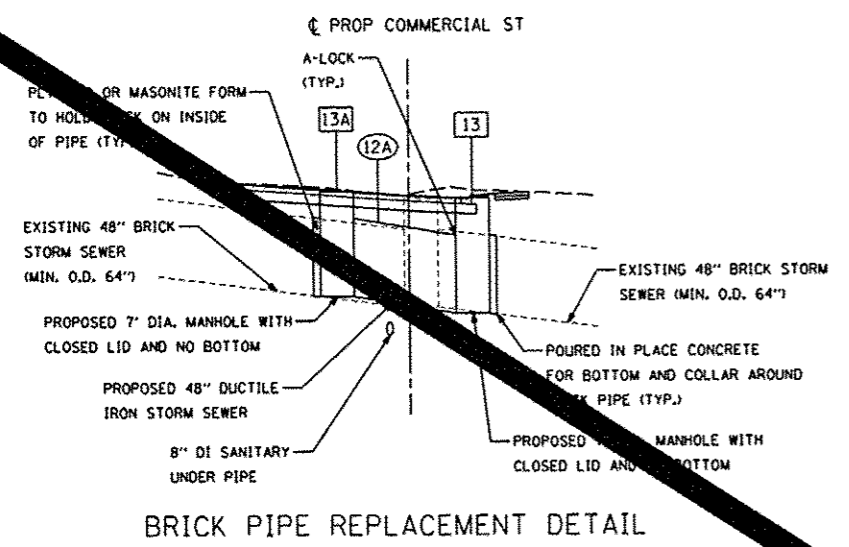

NOTE: ABOVE GROUND UTILITY ELEVATION SHALL BE ADJUSTED TO MEET PROWAG AND ADA STANDARDS



PIPE NUMBER	FROM STRUCTURE	U/S INVERT	TO STRUCTURE	D/S INVERT	CLASS TYPE	DIAM.	LEN.	SLOPE	CLSM
1	1	462.00	2	461.75	STORM SEWERS, CLASS A, TYPE 2	12	21.0		14
2	2	461.75	4	461.00	STORM SEWERS, CLASS A, TYPE 2	12	99.0	0.76	
3	3	461.50	4	461.25	STORM SEWERS, CLASS A, TYPE 2	12	21.0	1.19	
4	4	461.00	6	460.50	STORM SEWERS, CLASS A, TYPE 2	12	64.0	0.78	46
5	5	461.00	6	460.75	STORM SEWERS, CLASS A, TYPE 2	12	30.4	0.82	20
6	6	460.50	8	459.75	STORM SEWERS, CLASS A, TYPE 2	12	109.0	0.69	79

STRUCTURE NUMBER	STA	OFFSET	TYPE	RIM	INVERTS								
					N	NE	E	SE	S	SW	W	NW	
1	1709+50.00	11.33	LT DRYWELL, TYPE G-1, 4' DIA.	466.56				462.00					
2	1709+50.00	11.33	RT MANHOLE, TYPE G-1	466.56		461.75						461.75	
3	1710+50.00	11.33	LT MANHOLE, TYPE G-1	466.01				461.50					
4	1710+50.00	11.33	RT MANHOLE, TYPE G-1, 4' DIA.	466.01		461.00					461.00		461.25
5	1711+35.00	11.33	LT DRYWELL, TYPE G-1, 4' DIA.	465.55				461.00					
6	1711+15.00	11.33	RT INLET-MANHOLE, TYPE G-1, 4' DIA.	465.66		460.50				460.50			460.75

