

STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION

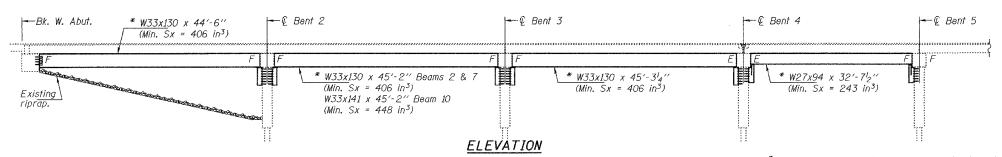

* Contractor is to verify beam length prior to ordering material. Other sections meeting the section modulus requirements shown may be allowed subject to approval by the Bureau of Bridges and Structures, however, no additional payment will be allowed if the contractor chooses a heavier steel section than the one specified in the plans. Maximum girder depth = 36", except Span 1, maximum girder depth = 33".

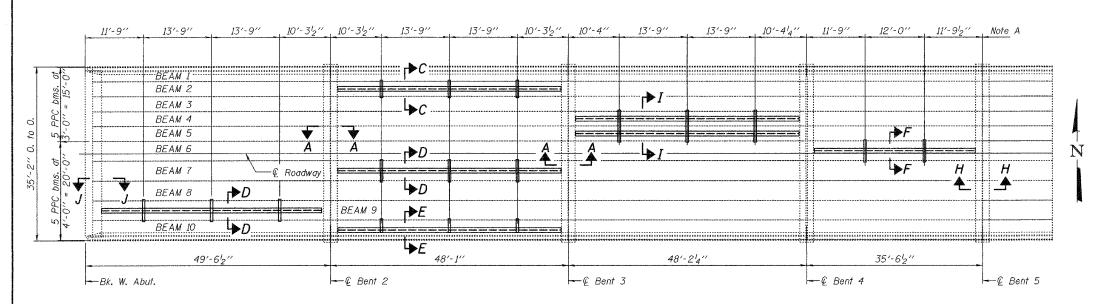


OCTOBER 9, 2007

PASSED Roll E. Allinon
ENGINEER OF BRIDGES AND STRUCTURES

shims at midpoints between tie plates. Securely weld shims to top flange of support beam. Min. shim size is 6" x flange width.

PLAN For Sections A-A thru J-J, see

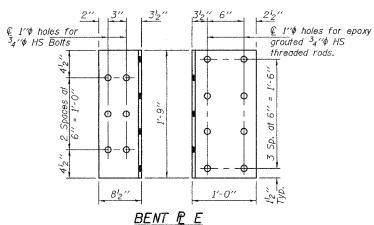

(2 Req'd)

P 2" x 1'-8" x 1'-9"

Expires: November 30, 2008

ROUTE NO. SHEET NO. 1 FA 752 5 4 Fayette FEO. ROAD DIST, NO. 7 ILLINOIS FEO. AID P

2 SHEETS

Contract Number: 74283

GENERAL NOTES

All structural steel shall conform to AASHTO Classification M-270 Gr. 36, unless otherwise noted.

Plan dimensions and details relative to existing plans are subject to routine variations. The Contractor shall field verify existing dimensions and details affecting new construction and make necessary approved adjustments prior to construction or ordering of materials. Such variations shall not be cause for additional compensation for a change in scope of the work, however, the Contractor will be paid for the quantity actually furnished based upon the unit price bid for the work.

See Section 584 of the Standard Specifications for Epoxy Grouting of Threaded Rods.


The cost of epoxy grouting threaded rods shall be included with

Furnishing and Erecting Structural Steel.

The Contractor has the option of using used steel. See special provisions.

The contractor is advised that the existing PPC Deck Beams are in a deteriorated condition with reduced load carrying capacity. It is the contractors responsibility to account for the condition of the beams when developing construction procedures.

If the contractor's procedure for placement of beams involves placement of cranes or other heavy equipment on the bridge, a detailed procedure shall be submitted to the Engineer for approval. The procedure shall include calculations, prepared and sealed by an Illinois Licensed Structural Engineer, verifying that the equipment and procedure used will not overstress the existing beams. To distribute load to multiple beams and protect the existing surface, in all cases a double layer mat of heavy timbers shall be used at all times under crane tracks or wheels and any outriggers in the down position. If necessary, shims shall be used under the crane mat to ensure uniform contact with the underlying beams.

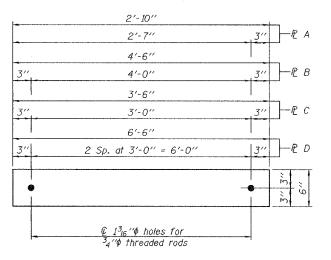

TRANSVERSE TIE P'S

P A 2" x 2'-10" x 6" (3 Req'd) ½" x 4'-6" x 6" (8 Req'd) C 2" x 3'-6" x 6" (3 Req'd) $\frac{R}{L} D \frac{T_2}{2}$ x 6'-6" x 6" (3 Req'd)

TOTAL RILL OF MATERIAL

The second secon			
ITEM		UNIT	QUANTITY
Furnishing and E	recting Structural Steel	Pound	42810

PLAN AND ELEVATION FA 752 FAYETTE COUNTY SN 026-0059

...\deck_beans_/y08\0260059.dgn 10/9/2007 10:47:43 AM

CHECKED

DESIGNED Victor H. Veliz

baliva

AJB VHV