*01-00590-00-BR (County) CONTRACT NO. 87293

23 SHEETS

NOTES

Railing shall be according to Section 509 of the Standard Specifications, except as noted, and will be paid for at the Contract Unit Price per foot for and Parapet Railing, Hollow structural sections shall conform to the requirements


Hollow structural sections shall conform to the requirement of ASTM designation A 500, Grade B, structural steel tubing. All other steel shapes and plates shall conform to the requirements of AASHTO M 270 Grade 36.

If the option of drilling and epoxy grouting the anchor rods is chosen, the Contractor shall use the capsule or the adhesive cartridge type anchor rods that have been previously tested and given a prior approval by the Department. The Contractor shall install these anchor rods in pre-drilled holes according to the manufacturer's recommendations and procedures. The capsule or the adhesive cartridge shall be sealed with pre-measured amounts of the adhesive chemical.

Space reinforcement to miss anchor rods.

All posts, railing, splices, anchor devices, and plates shall be galvanized after shop fabrication according to AASHTO M 111 and ASTM A 385. All bolts, nuts, washers, and anchor rods shall be galvanized according to AASHTO M 232 except stainless steel bolts as noted.

Vent holes for galvanizing shall be placed in the posts and rails at locations that will not allow the accumulation of moisture in the members.

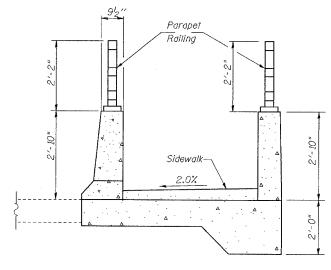

SECTION THRU SIDEWALK (South Wall)

BILL OF MATERIAL

Item	Unit	Quantity
Parapet Railing	Foot	1,367

PARAPET RAILING

MSE WALL NO. 1 & 2

FAU ROUTE 6145


SECTION 01-00590-00-BR (COUNTY)


LASALLE COUNTY

STATION 16+66.11 TO 27+40.27

HUTCHISON ENGINEERING, INC. JACKSONVILLE & JOLIET, ILLINOIS


Date: 3 /10 /2006

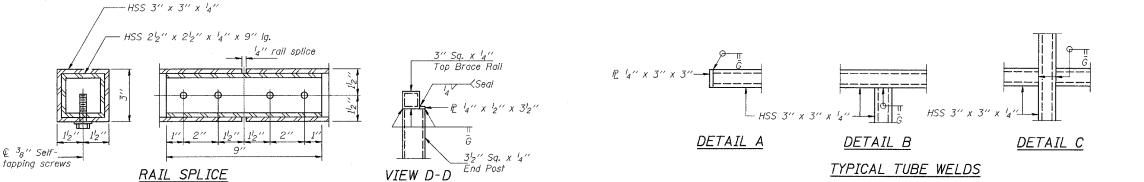


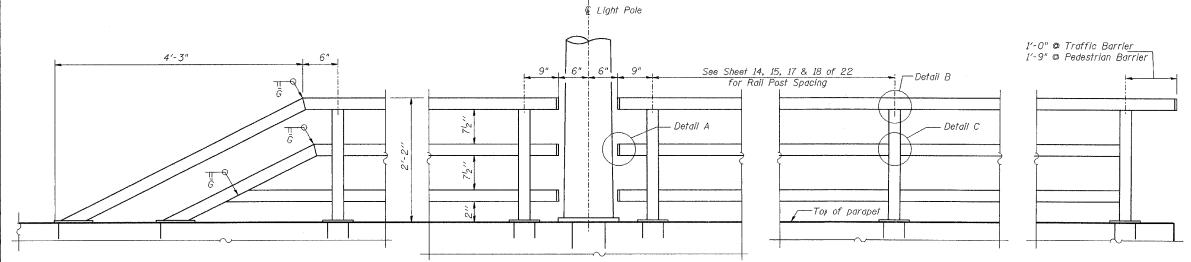

ELEVATION PARAPET RAILING

(Inside Face of Three Element Rail)

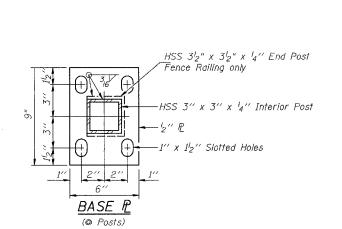

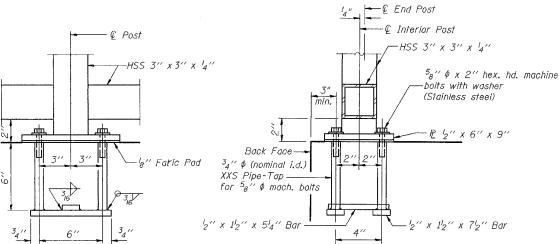

<u>ANCHORBOLT DETAILS</u>

In lieu of the cat-in-place anchor device shown, the Contractor has to option of drilling and epoxy grouting ${}^5\!g^{\prime\prime}$ ϕ anchr rods. Embedment shall be according to the maufacturer's specifications.

DESIGNED JOH CHECKED BRT DRAWN TD CHECKED JOH

PARAPET RAILING

ELEVATION AT EXPANSION JOINT

2190b021r