

F.A.P. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
303	I29K	WINNEBAGO	585	174

LIGHT POLE HEIGHT	BOLT CIRCLE DIAMETER	STEEL FOUNDATION		CONCRETE FOUNDATION		
		SHAFT DIAMETER	SHAFT DEPTH	SHAFT DIAMETER	SHAFT DEPTH	ANCHOR ROD LENGTH *
≤ 9 m (30')	292 mm (11 1/2")	220 mm (8 5/8")	1.83 m (6'-0")	600 mm (24")	1.52 m (5'-0")	1.45 m (4'-9")
9.4 m - 10.7 m (31'-35')	292 mm (11 1/2")	220 mm (8 5/8")	1.83 m (6'-0")	600 mm (24")	1.67 m (5'-6")	1.60 m (5'-3")
11.9 m - 12.0 m (36'-40')	381 mm (15")	220 mm (8 5/8")	1.83 m ** (6'-0")	600 mm (24")	1.83 m (6'-0")	1.75 m (5'-9")
12.5 m - 13.7 m (41'-45')	381 mm (15")	220 mm (8 5/8")	1.83 m ** (6'-0")	600 mm (24")	1.98 m (6'-6")	1.90 m (6'-3")
14.0 m - 16.0 m (46'-50')	381 mm (15")	220 mm (8 5/8")	2.44 m (8'-0")	600 mm (24")	2.13 m (7'-0")	2.00 m (6'-9")

\* Length does not include 100 (4) hook  
 \*\* 220 mm x 2.44 m (8 5/8" x 8'-0") for Twin luminaires

Notes:

All foundations are designed to be located on slopes not exceeding 2:1 where soils have an unconfined compressive strength of at least 1.0 TSF. The contractor shall verify the soil strength during drilling for concrete foundations or by monitoring installation resistance on steel foundations and notify the engineer if other conditions are encountered.

Notes:

Wireway may be on front, back, or side of foundation as required by the trenching. Place door of transformer base on wireway side to minimize the number of unit duct bends.


Top of schedule 40 PVC 125 (5) I.D. PVC wiring window, shall be flush with the top of foundation for drainage.

75 (3) Min. concrete cover on all steel  
 25 (1) Steel anchor rod with 230 (9) of threads. See table for the required bolt circle diameter.


Anchor rod shall extend through nut 10 to 25 (3/8 to 1). For barrier or foundations located behind guardrail, use self-locking nut and flat washer. Do not use lock washer. Length above foundation shall be adjusted to accommodate breakaway devices furnished by the contractor for a specific installation.

Use dirt removed from foundation to meet 1.5 m (5 ft.) chord fill around foundation top. Grade dirt level with bottom of concrete chamfer.


\*\*\* If the required anchor rod length above top of foundation is less than 75 (3), anchor rods may be lowered below 150 (6).

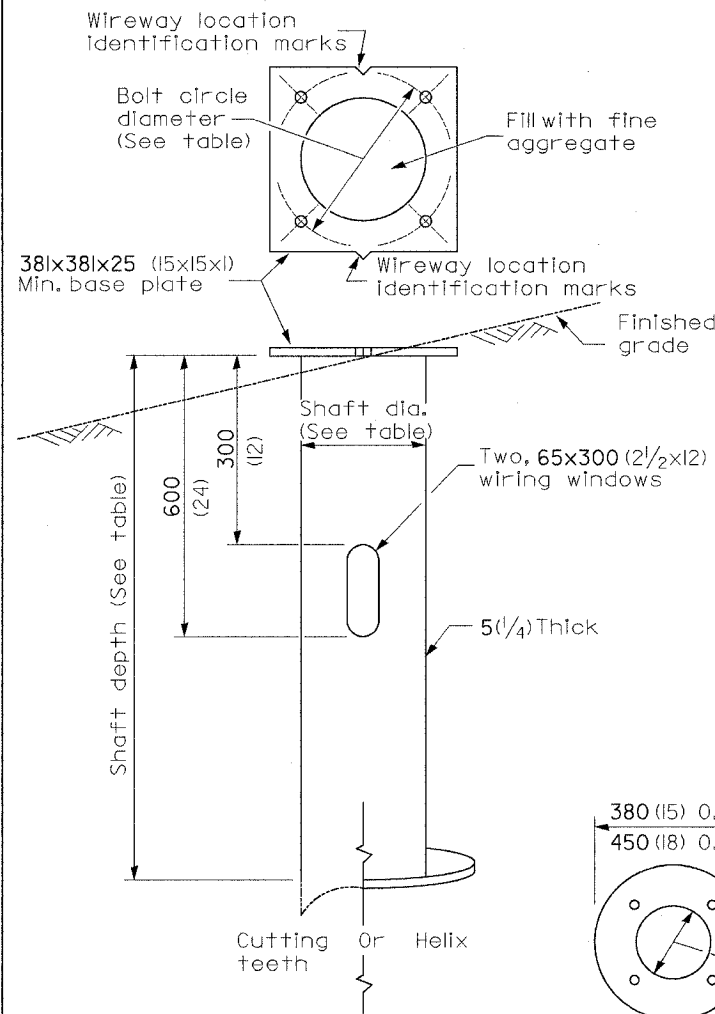


STEEL FOUNDATION

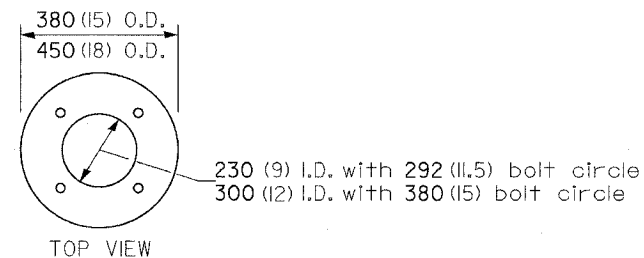

RING PLATE DETAIL  
 (When rock is encountered and foundation is shallower)

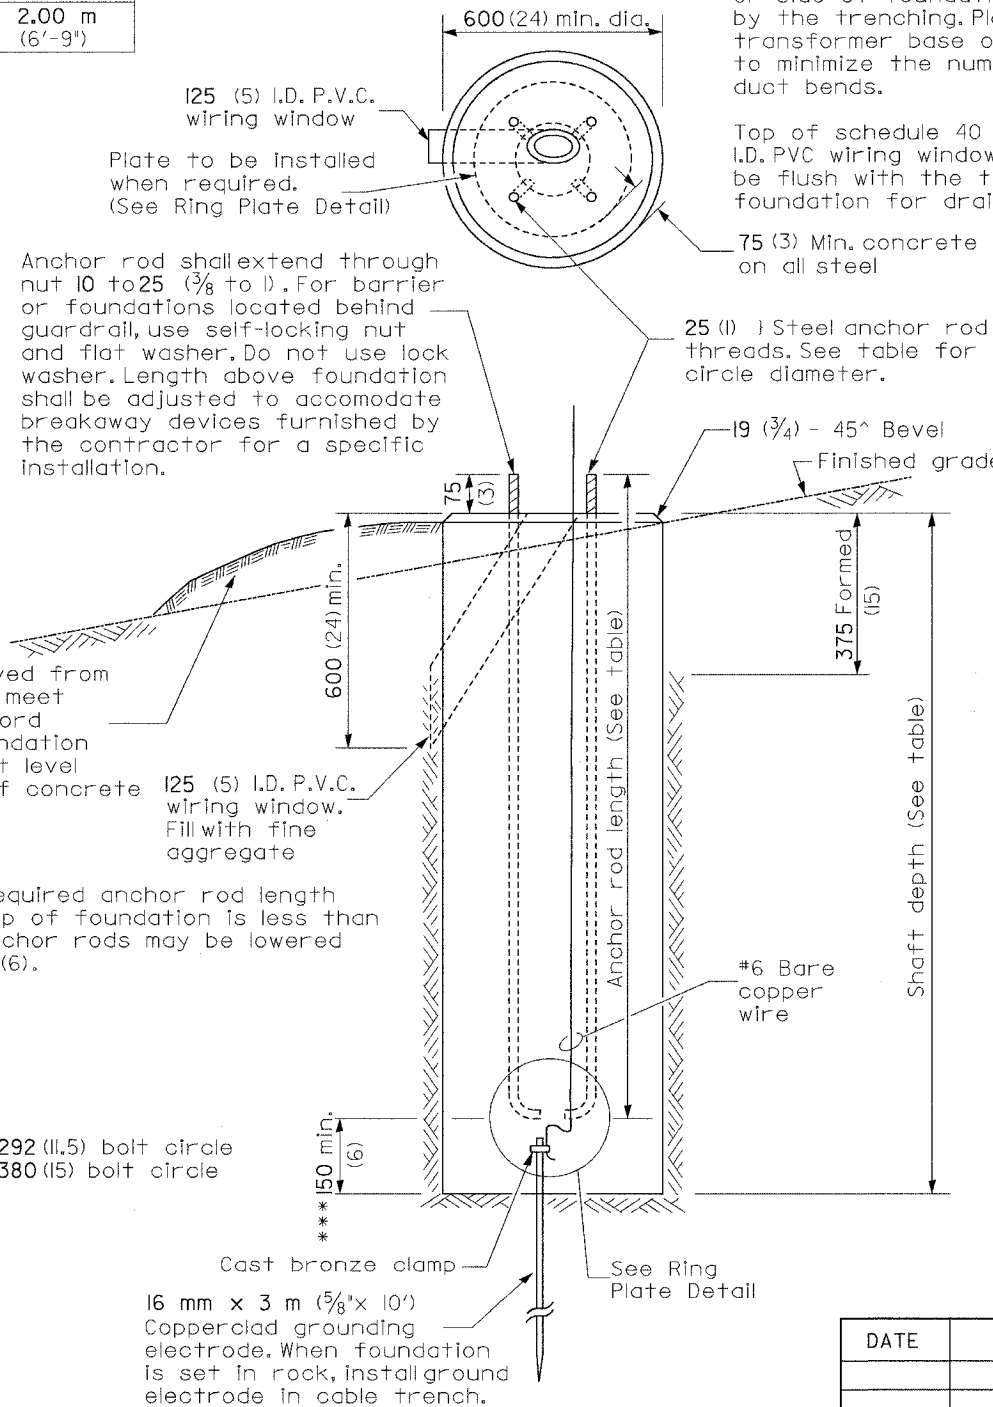

CONCRETE FOUNDATION

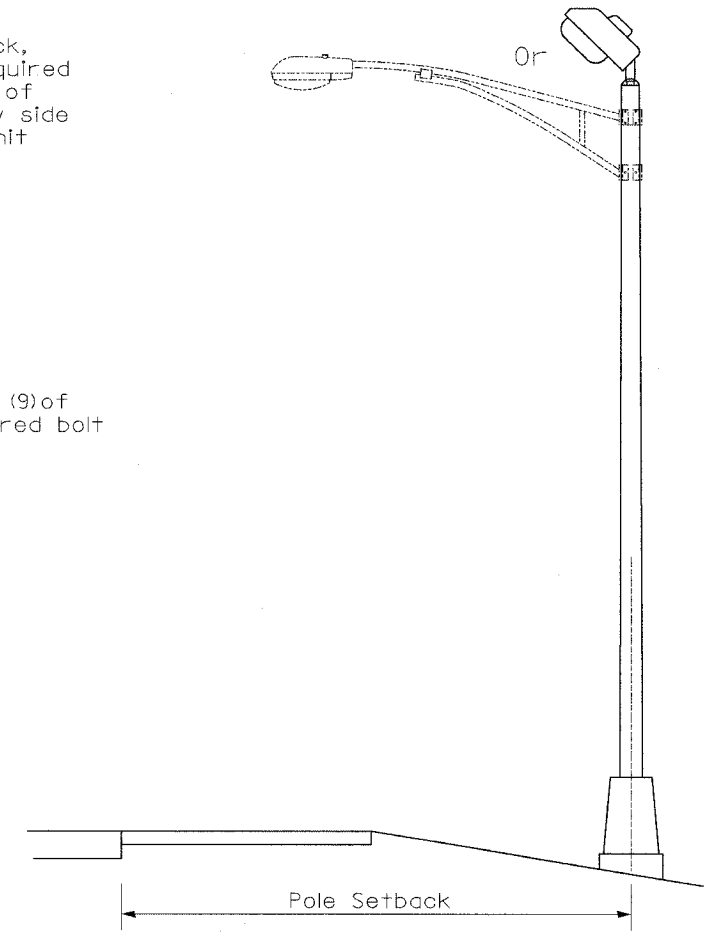

Pole Foundation Setback:

For horizontal mounted luminaires, setback shall be a minimum of 6.1 m (20') from edge of pavement.

For vertical mount luminaires, setback shall be a minimum of 9 m (30') from edge of pavement. Poles shall be located 1.5 m (5') behind guardrail or other protective barriers, or as directed by the Engineer.

All dimensions are in millimeters (inches) unless otherwise shown.

DATE	REVISIONS

LIGHT POLE FOUNDATION

LGT836