

All components of the Transverse Pipe Grate shall be galvanized according to the requirements of AASHTO M 111 or M 232 as applicable.

Specifications unless noted otherwise.

Structural steel shapes and plates shall conform to the requirements of Article 1006.04 of the Standard Specifications. Steel pipes shall conform to the requirements of ASTM A 53 (Type E or S), Grade B.


Anchor rods shall conform to the requirements of ASTM F1554, Grade 105. Anchor rods shall be drilled and epoxy arouted according to the requirements of Section 584 of the Standard Specifications. The chemical adhesive system shall be capable of achieving a minimum proof load of 5000 pounds and an ultimate shear capacity of 8000 pounds per anchor.

Bolts and thru bolts shall conform to the requirements of Article 1006.08 of the Standard Specifications except threaded rods conforming to the requirements of ASTM F1554. Grade 105 may be used for the thru bolts.


1¹₂" unless noted otherwise.

Bolts and anchor rods shall be snug tightened by a few impacts of an impact wrench or the full force of a worker using an ordinary spud wrench.


All cost associated with fabricating, furnishing, and installing the Transverse Pipe Grate shall be included in the contract unit price for Transverse Pipe Grate.

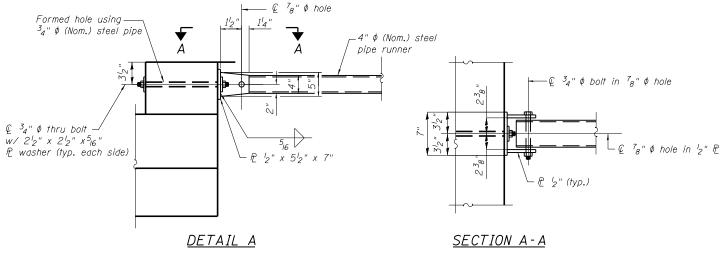


*



<u>SECTION B</u>-B (See Detail A for dimensions and details not shown.)

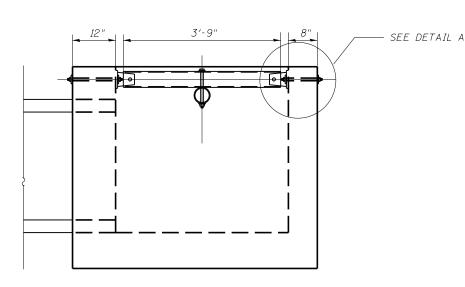

LONGITUDINAL SECTION

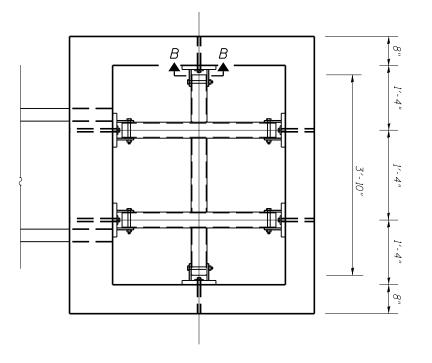

PLAN VIEW


FILE NAME = USER NAME = crespole DESIGNED REVISED TRANSVERSE PIP STATE OF ILLINOIS c:\pw_work\pwidot\crespole\d0330150\D488792-sht-details.don DRAWN REVISED RT. STA. 16 + 75.00 (LEG PLOT SCALE = 40.0000 '/ in. CHECKED REVISED **DEPARTMENT OF TRANSPORTATION** PLOT DATE = 8/15/2013 SCALE: SHEET NO. OF SHEETS DATE REVISED

<u>GENERAL NOTES</u>

Length and number of steel pipes shall be determined by the Contractor except as shown. All steel pipe shall

Fabrication of the Transverse Pipe Grate System shall conform to the requirements in Section 505 of the Standard

The minimum edge distance from the center of a hole to the free edge of a structural shape or plate shall be



SECTION C-C

** Measured perpendicular to top of culvert wall. In addition, formed hole shall be located a minimum of 6" measured horizontally from any vertical joints necessary for construction of the culvert end section.

PE GRATE GION HALL ROAD)			F.A.S. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
			1380	7W-1,RS-3	Peoria	617	333
					CONTRACT	NO. 8	8792
5	STA.	TO STA.		ILLINOIS FED. AID PROJECT			