


F.A.Z. RTE.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
90/94	2003-015	COOK	476	468
STA.		TO STA.		
FED. ROAD DIST. NO. 4		ILLINOIS FED. AID PROJECT		62583

NOTES:


- 1.- ALL CONDUIT BUSHINGS SHALL HAVE AN ISOLATED THROAT.
- 2.- PROVIDE HEAT SHRINK BOOT AT THE TOP OF THE SERVICE ENTRANCE CABLE FOR MOISTURE PROOFING.
- 3.- ALL CONNECTIONS TO GROUND RODS SHALL BE EXOTHERMIC UNLESS OTHERWISE NOTED.
- 4.- ATTACH INCOMING ELECTRIC SERVICE CABLE TO UTILITY POLE EVERY 5 FEET USING INSULATED U-NAIL.
- 5.- PROVIDE CABLE RACK IN HANDHOLES.
- 6.- ALL CONDUCTORS SHALL BE COPPER.
- 7.- PROVIDE STAINLESS STEEL HARDWARE TO ATTACH L BRACKETS TO UNISTRUT AND TO SIGN HANGER.

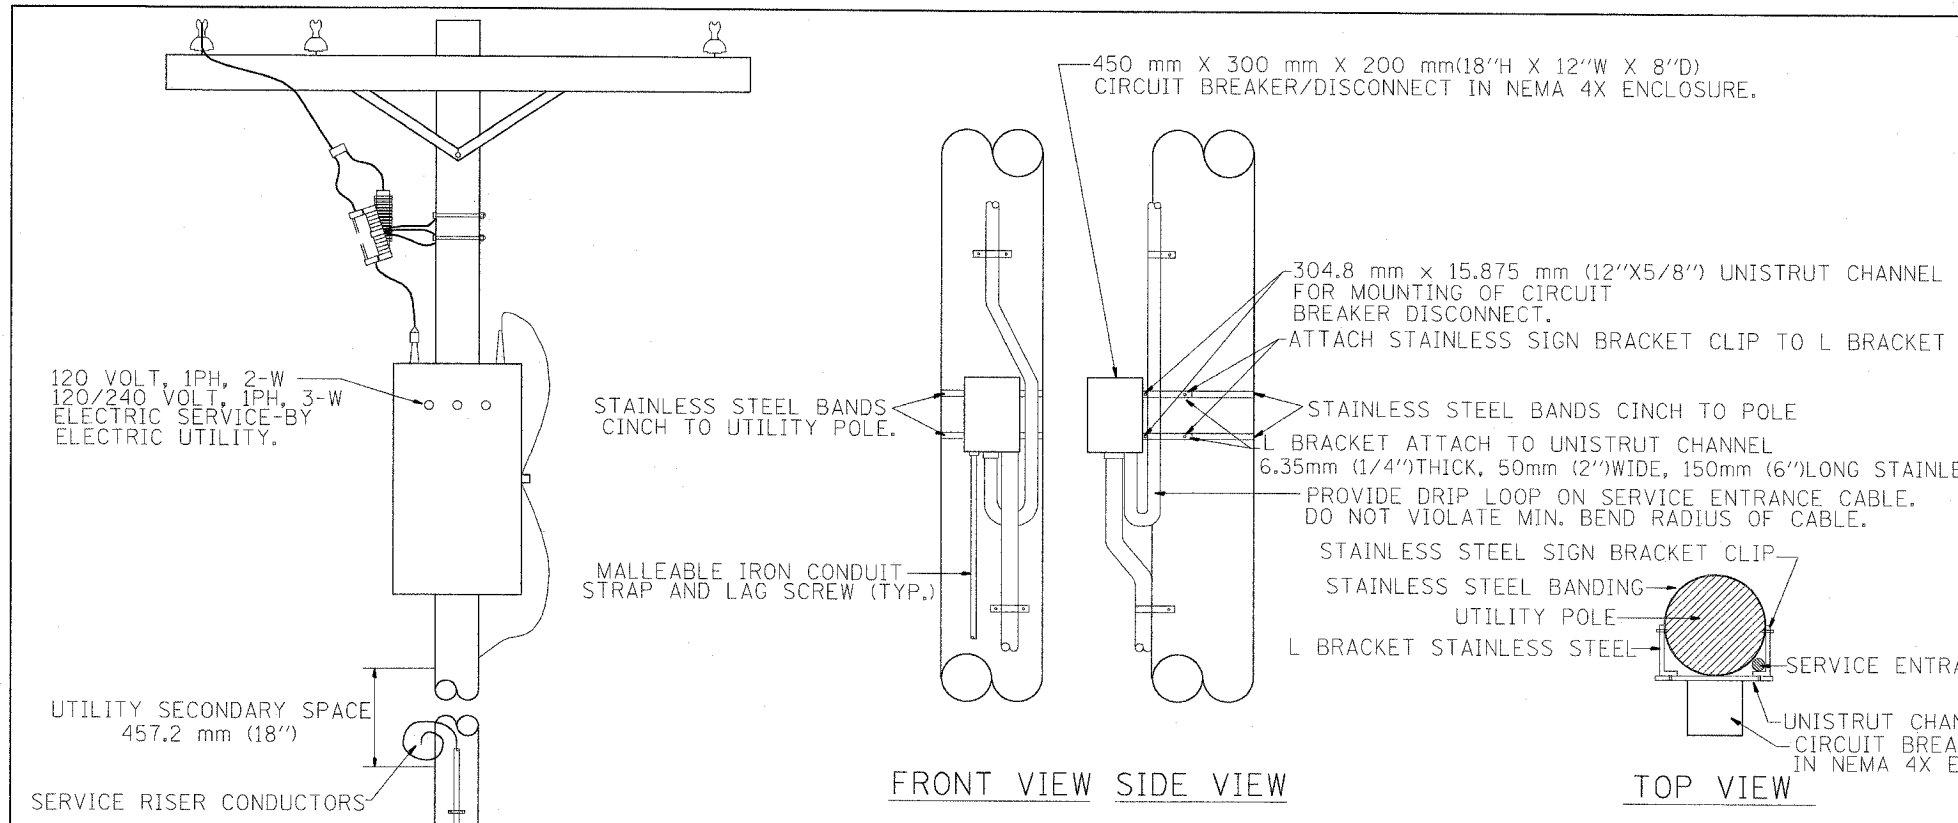

FRONT VIEW SIDE VIEW

TOP VIEW

NTS
DISCONNECT MOUNTING DETAIL

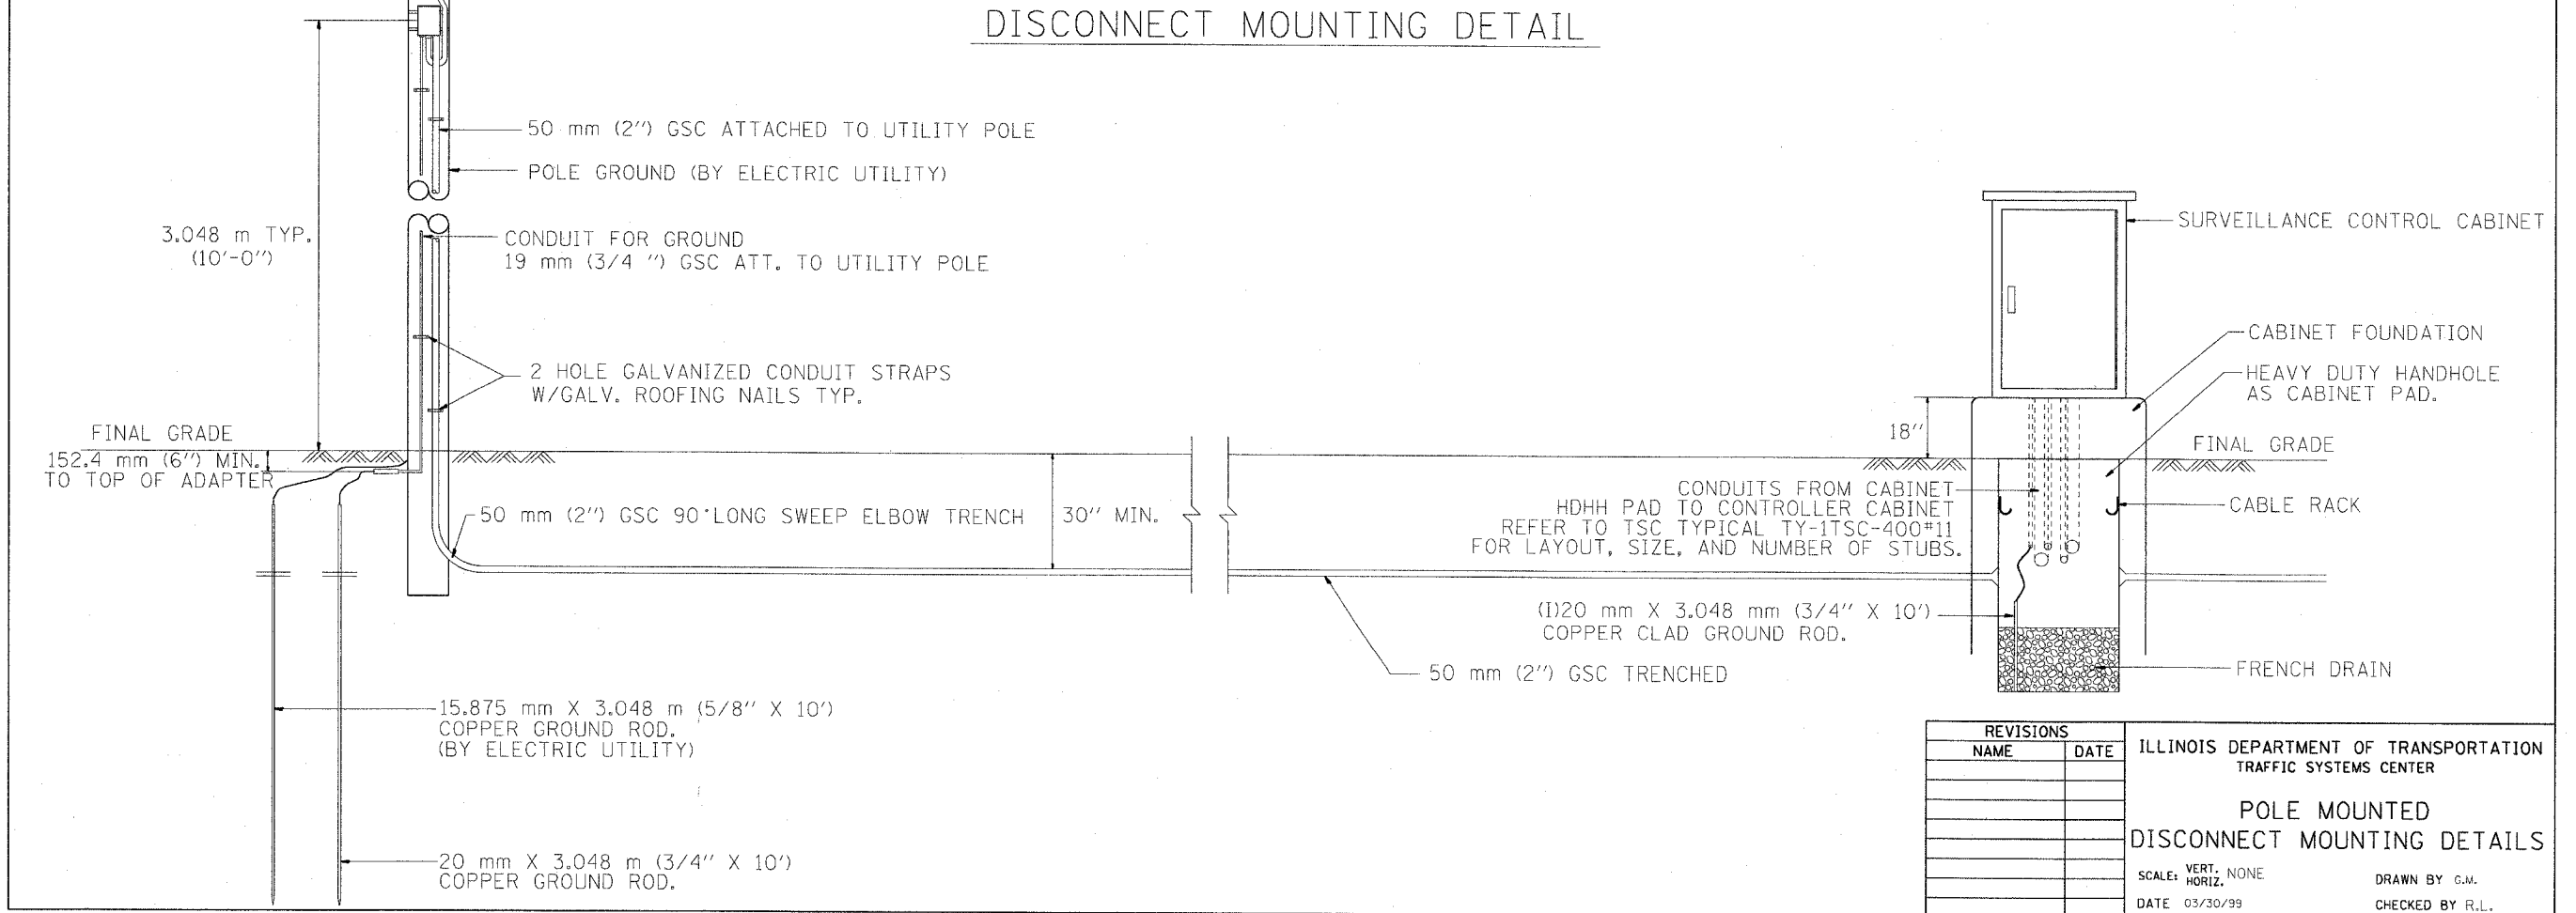

REVISIONS		ILLINOIS DEPARTMENT OF TRANSPORTATION TRAFFIC SYSTEMS CENTER
NAME	DATE	
		POLE MOUNTED DISCONNECT MOUNTING DETAILS SCALE: VERT. NONE HORIZ. NONE DATE 03/30/99 DRAWN BY G.W. CHECKED BY R.L.

RD= TYPMET/DCN
RF=

VI-40020