


FABRIC BEARING PAD
(Interior - 10 Req'd.)


FABRIC BEARING PAD
(Exterior - 4 Req'd.)

FIXED


Notes:
All bearing pads shall be 1" thick.
Omit holes when using expansion bearings.
Expansion bearing pad shall be bonded to the substructure.

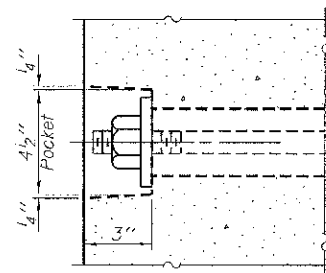


SECTION A-A

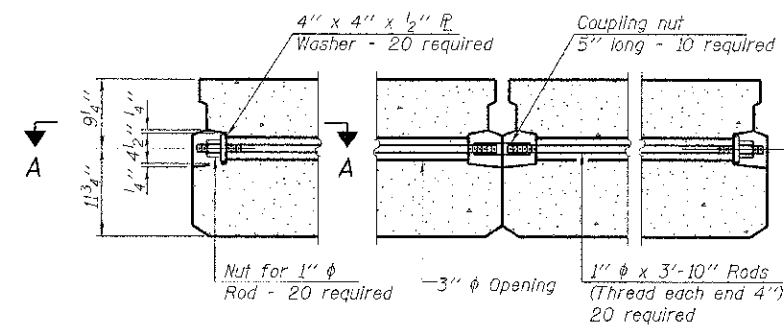


TYPICAL TRANSVERSE TIE ASSEMBLY

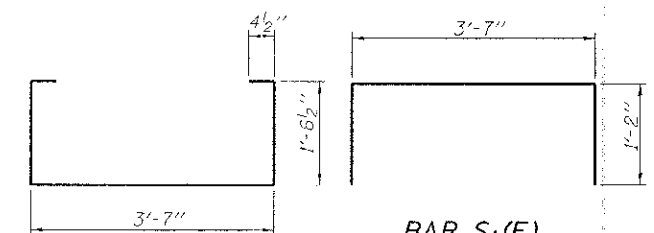


BAR $S_1(E)$

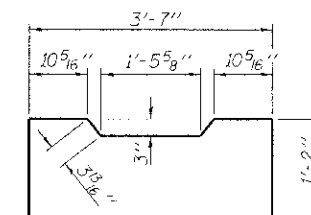


BAR S(E)




BAR U(E)

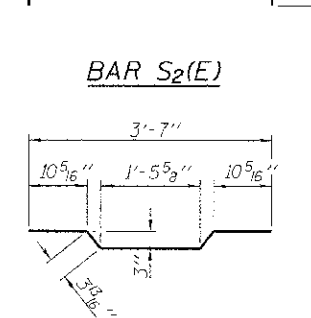


BAR $S_2(E)$



BAR $U_1(E)$

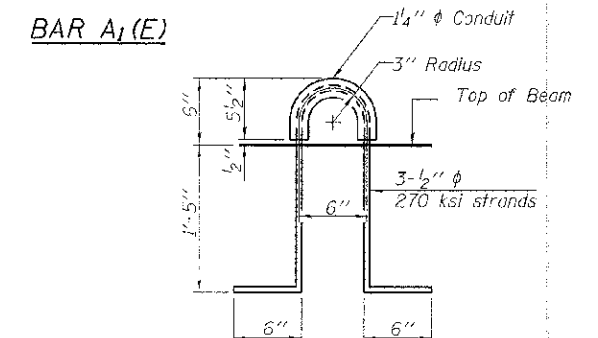

LIFTING LOOP DETAIL

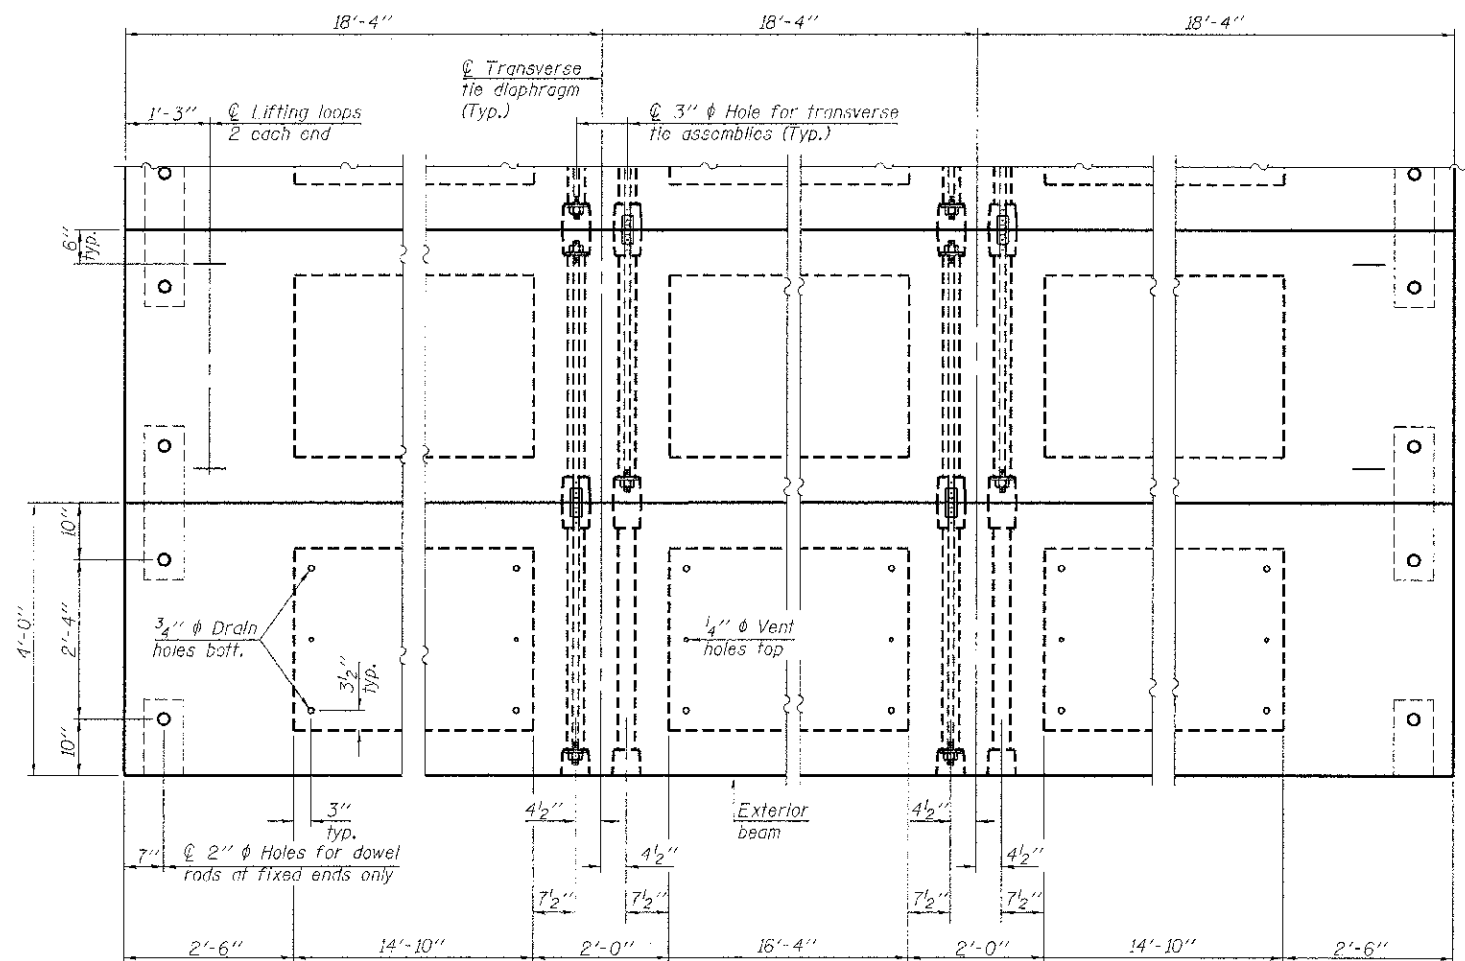

PLAN VIEW

Note: Connect beams in pairs with the transverse tie configuration shown.

NOTES

Prestressing steel shall be uncoated high strength, low relaxation 7-wire strand, Grade 270. The nominal diameter shall be $\frac{1}{2}$ " and the nominal cross-sectional area shall be 0.153 sq. in. The 1" ϕ rods in the transverse tie assembly shall be tightened to a snug fit and the threads set. Pockets on exterior faces of bridge shall be filled with grout after transverse tie assembly is in place.

Reinforcement bars shall conform to ASTM A 706, Grade 60. (See Special Provisions).
Two $\frac{1}{2}$ " fabric adjusting shims of the dimensions of the exterior bearing pad shall be provided for each bearing pad location.
A minimum $2\frac{1}{2}$ " ϕ lifting pin shall be used to engage the lifting loops during handling.
Corrosion inhibitor, per Article 1020.05(b)(12) and 1021.07 of the Standard Specifications, shall be used in the concrete for precast prestressed concrete deck beams.
Compressive strength of prestressed concrete, f'c, shall be 6000 psi.
Compressive strength of prestressed concrete at release, f'cr, shall be 5000 psi.
All reinforcement shall be epoxy coated.

BILL OF MATERIAL

Precast Prestressed Cong. Deck Bms. (21" depth)	Sq. Ft.	1,320
--	---------	-------

PD-2148-0D

7-1-10

FILE NAME = 100369-sht-bridge.dgn	USER NAME =	DESIGNED - D.W.T.	REVISED -
HAMPTON, LENZINI AND RENWICK, INC. 380 STEVENSON DRIVE, SUITE 101 ARNDORF, IL 60017-0278	PLOT SCALE =	CHECKED - S.W.M.	REVISED -
ILLINOIS PROFESSIONAL DESIGN FIRM STATE OF ILL. SEC. 120 - THE GEODESIC	PLOT DATE = 10/2/2012	DRAWN - D.A.B.	REVISED -
		CHECKED - S.W.M.	REVISED -

STATE OF ILLINOIS
EDWARDS COUNTY HIGHWAY DEPARTMENT

21" x 48" PPC DECK BEAM DETAILS
STRUCTURE NO. 024-3142

SHEET NO. 3 OF 9 SHEETS

T.R.	SECTION	COUNTY	TOTAL SHEETS	SHEET NO.
62	10-0211B-00-BR	EDWARDS	13	7
ROAD DISTRICT #2		CONTRACT NO. 95683		
ILL. INDS. FED. AID PROJECT RECS-047(037)				