

WATER MAIN PIPE

- WM6-1 165' D I WATER MAIN 12 DEFLECT PIPE ±3.3" TRENCH BACKFILL 139.4 CU YD
- WM6-2 37' D I WATER MAIN 12 TRENCH BACKFILL 31.5 CU YD
- WM6-3 45' D I WATER MAIN 12 DEFLECT PIPE ±2.7" TRENCH BACKFILL 38.4 CU YD
- WM6-4 146' D I WATER MAIN 12 TRENCH BACKFILL 117.9 CU YD
- WM6-5 6' D I WATER MAIN 12 TRENCH BACKFILL 6.0 CU YD
- WM6-6 29' D I WATER MAIN 12 TRENCH BACKFILL 34.3 CU YD
- WM6-7 49' D I WATER MAIN 12 TRENCH BACKFILL 51.4 CU YD

WATER MAIN FITTINGS

- WM6-8 6' D I WATER MAIN 12 TRENCH BACKFILL 5.7 CU YD
- WM6-9 29' D I WATER MAIN 12 TRENCH BACKFILL 20.5 CU YD
- WM6-10 1' D I WATER MAIN 6 TRENCH BACKFILL 1.0 CU YD
- WM6-11 5' D I WATER MAIN 6 TRENCH BACKFILL 4.0 CU YD
- WM6-12 2' D I WATER MAIN 6 TRENCH BACKFILL 2.0 CU YD
- F6-1 DI WAT MN TEE, 12X6 4037+98.4 67.9 RT, R 709.0, C 703.0 TRENCH BACKFILL 1.7 CU YD
- F6-2 DI WT MNF 12 22.50 DB VM 4039+90.3 70.0 RT, R 708.4, C 703.0 TRENCH BACKFILL 1.5 CU YD

WATER MAIN VALVES

- F6-3 DI WT MNF 12 22.50 DB VM 4039+92.0 70.8 RT, R 708.4, C 703.0 TRENCH BACKFILL 1.5 CU YD
- F6-4 DI WT MNF 12 22.50 DB VM 4039+99.0 73.8 RT, R 708.5, C 700.0 TRENCH BACKFILL 2.5 CU YD
- F6-5 DI WT MNF 12 11.25 DB 4040+27.1 85.8 RT, R 707.9, C 700.0 TRENCH BACKFILL 2.3 CU YD
- F6-6 DI WT MNF 12 45.0 DB 4040+68.7 114.4 RT, R 706.7, C 700.0 TRENCH BACKFILL 1.9 CU YD
- F6-7 DI WAT MN TEE, 12X6 4040+75.6 112.8 RT, R 706.6, C 700.0 TRENCH BACKFILL 1.9 CU YD
- F6-8 DI WT MNF 6 45.0 DB VM 4037+98.3 69.9 RT, R 709.0, C 700.7 TRENCH BACKFILL 1.7 CU YD

POINT OF DEFLECTION

- POD6-1 4037+60.0 66.0 RT
- POD6-2 4038+43.4 70.0 RT

WATER MAIN LINE STOPS

- LS6-1 WM LINE STOP 12 4040+90.3 33.7 RT

WATER SERVICE CONNECTIONS

- WSC6-1 WAT SER CONN 1 1/2 4036+44.2 66.0 RT, R 709.2, C 703.0
- WSC6-2 WAT SER CONN 1 4036+54.4 66.0 RT, R 709.2, C 703.0
- WSC6-3 WAT SER CONN 1 4038+24.5 69.1 RT, R 708.8, C 703.0

FIRE HYDRANTS

- FH6-1 FIRE HYD W/AUX V & VB 4037+98.0 77.1 RT, N 711.0, R 709.0, C 700.7
- FH6-2 FIRE HY W/AUX V & VB 4040+77.2 120.3 RT, N 708.5, R 706.5, C 700.0

WATER SERVICE LINE

- WS6-1 9' WATER SERV LINE 1 1/2 TRENCH BACKFILL 7.0 CU YD
- WS6-2 9' WATER SERV LINE 1 TRENCH BACKFILL 7.0 CU YD
- WS6-3 9' WATER SERV LINE 1 TRENCH BACKFILL 3.5 CU YD

DOMESTIC WATER SERVICE BOX


- DB6-1 DOM WAT SER BOX 4036+44.2 73.6 RT, R 709.4, C 700.7
- DB6-2 DOM WAT SER BOX 4036+54.4 73.6 RT, R 709.5, C 700.7
- DB6-3 DOM WAT SER BOX 4038+24.6 67.1 RT, R 708.4, C 703.0

CUT & CAP WATER MAIN

- CC6-1 CUT & CAP EX 10 WM 4039+94.8 58.7 RT, R 708.0, C 700.2 TRENCH BACKFILL 1.7 CU YD
- CC6-2 CUT & CAP EX 10 WM 4040+04.7 58.3 RT, R 708.0, C 700.2 TRENCH BACKFILL 1.7 CU YD
- CC6-3 CUT & CAP EX 10 WM 4040+90.8 53.3 RT, R 707.8, C 700.0 TRENCH BACKFILL 1.7 CU YD


NOTES

1. MAKE PRESSURE CONNECTION IN VAULT. SEE STANDARD DETAIL FOR MORE INFORMATION. PRESSURE CONNECTION INCLUDED WITH COST OF TAPPING VALVE AND SLEEVE.

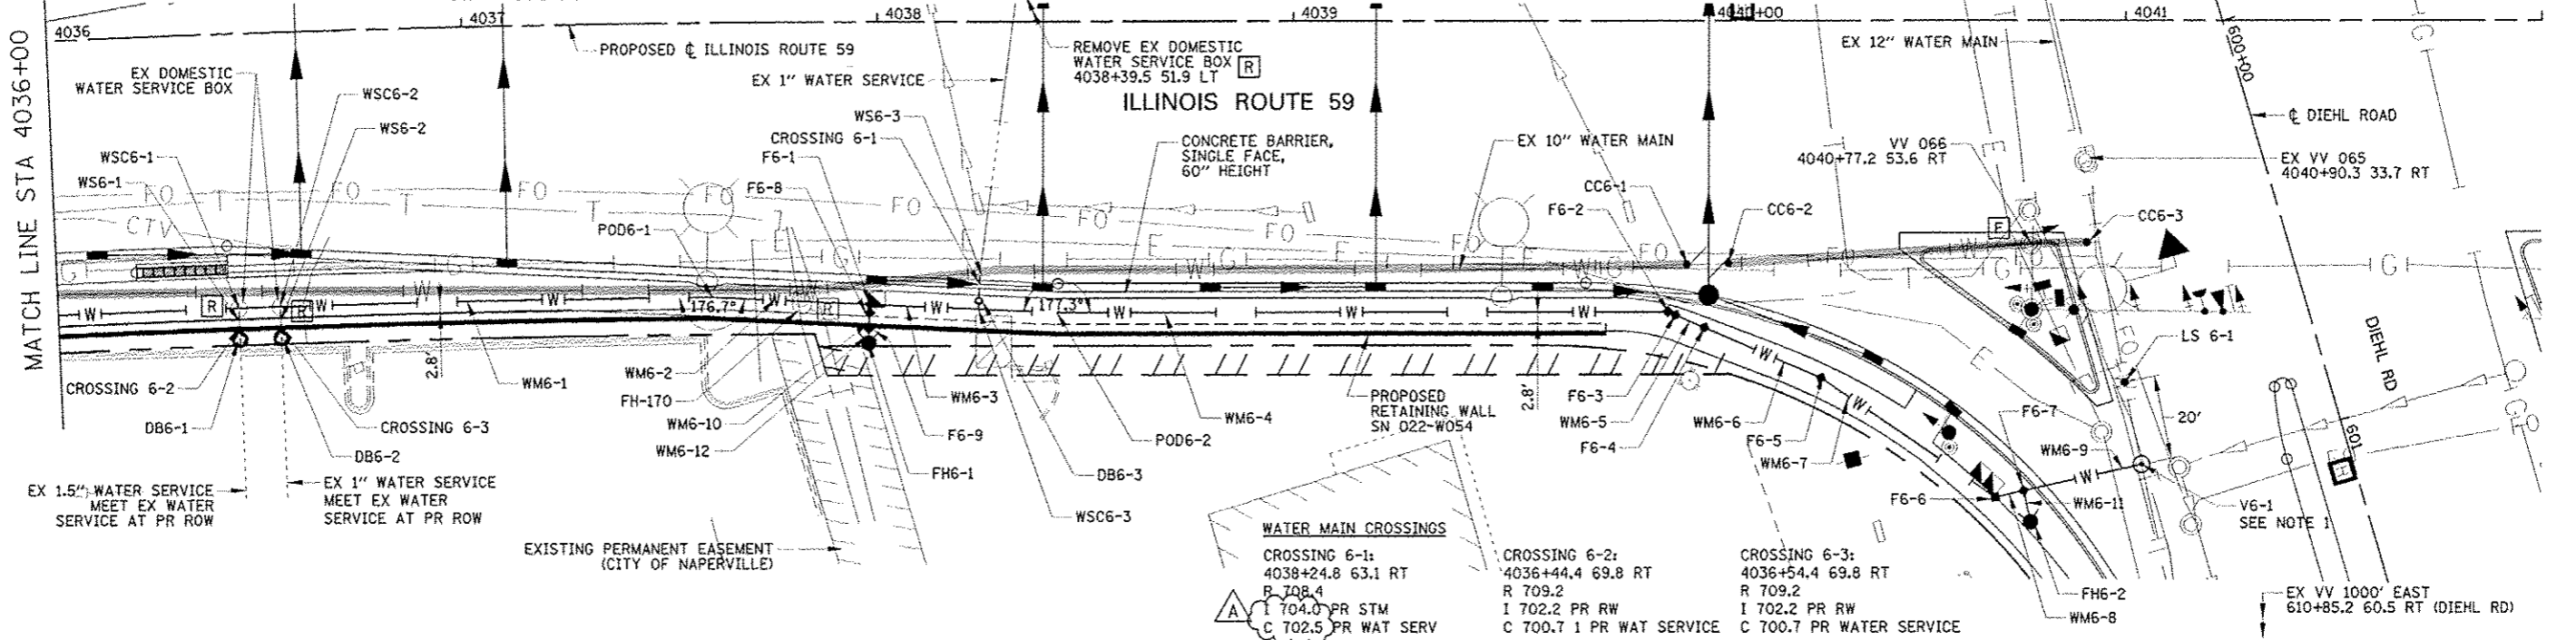

WATER MAIN CROSSINGS

CROSSING 6-1: 4036+24.8 63.1 RT R 708.4 I 704.0 PR STM C 702.5 PR WAT SERV	CROSSING 6-2: 4036+44.4 69.8 RT R 709.2 I 702.2 PR RW C 700.7 PR WAT SERVICE	CROSSING 6-3: 4036+54.4 69.8 RT R 709.2 I 702.2 PR RW C 700.7 PR WAT SERVICE
---	---	---

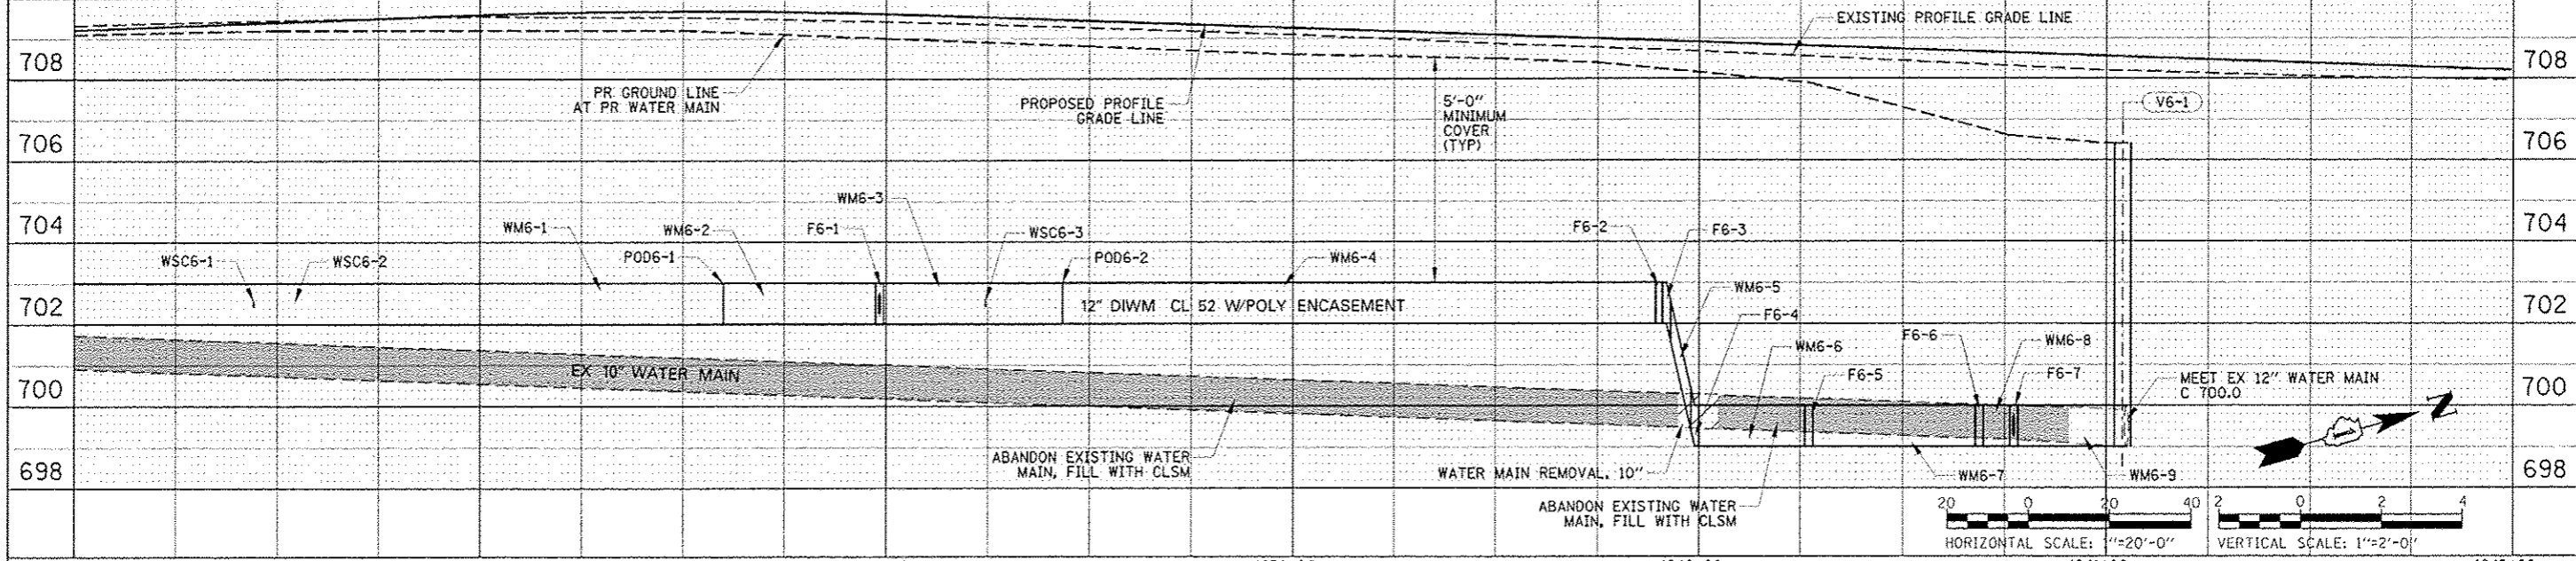

DESIGNED: <i>CEO</i>	REVISED - ADDENDUM A 02/22/2013	STATE OF ILLINOIS DEPARTMENT OF TRANSPORTATION	WATER MAIN PLAN AND PROFILE		F.A.P. RTE. 338	SECTION (112 & 113) WRS-6	COUNTY DUPAGE	TOTAL SHEETS 734	SHEET NO. 322	
DRAWN: <i>CMW</i>	REVISED -		SCALE: SHEET NO. 6 OF 6 SHEETS STA. 4036+00 TO STA. 4042+00			WAT PP-6		CONTRACT NO. 60R31		
CHECKED: <i>JCM</i>	REVISED -									
DATE: 12/14/2012	REVISED -									