


- NOTES:
- 1) THE OPEN ENDS SHALL BE PROTECTED FROM DEBRIS AND GROUNDWATER ENTERING THE LATERAL WITH AN APPROVED PLUG
 - 2) MAXIMUM SLOPE SHALL BE LESS THAN 1:1 WHEN IT IS NECESSARY TO SECURE BEDDING IN UNDISTURBED EARTH.
 - 3) WHEN A SERVICE CONNECTION IS TAPPED INTO PVC MAIN, THEN A SEWER SADDLE SHALL BE USED. CLOW TYPE "SEALTITE" OR APPROVED EQUAL. BANDS, NUTS AND BOLTS MUST BE STAINLESS STEEL.
 - 4) SDR 26 PVC PIPE MEETING REQUIREMENTS OF ASTM D-2241-05 AND JOINTS CONFORMING TO ASTM D-3139-98(2005) OR LATEST EDITIONS.

Title:		RISER FOR SERVICE LATERAL		CITY OF NAPERVILLE STANDARD DETAIL	
Approved By:		DATE: 4/06/11	REV:	Detail: SAN 4	
		SCALE: NTS			

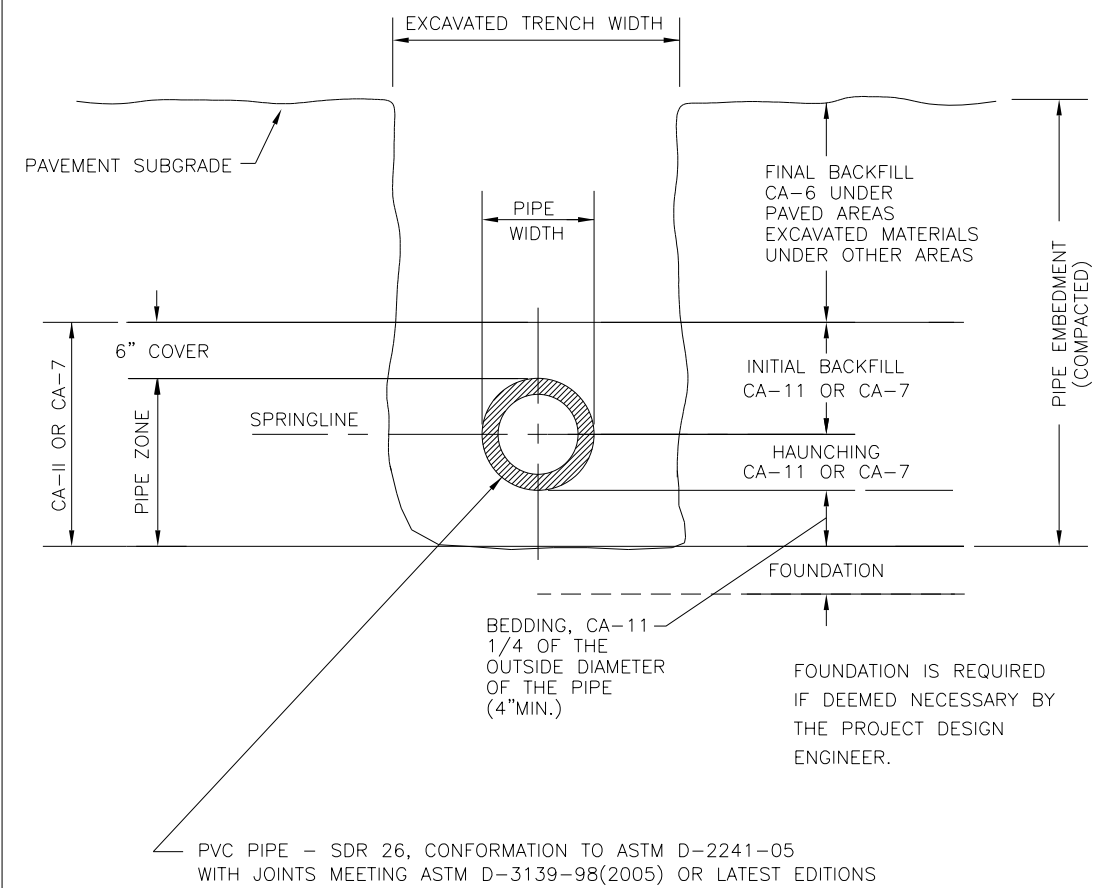

NOTE:
IN PAVED AREAS, ALL TRENCHES MUST BE COMPACTED IN CONFORMANCE WITH SECTION 550.07 OF THE STANDARD SPECIFICATIONS FOR ROAD & BRIDGE CONSTRUCTION

Title:		PVC TRENCH CROSS SECTION		CITY OF NAPERVILLE STANDARD DETAIL	
Approved By:		DATE: 4/06/11	REV:	Detail: SAN 10	
		SCALE: NTS			