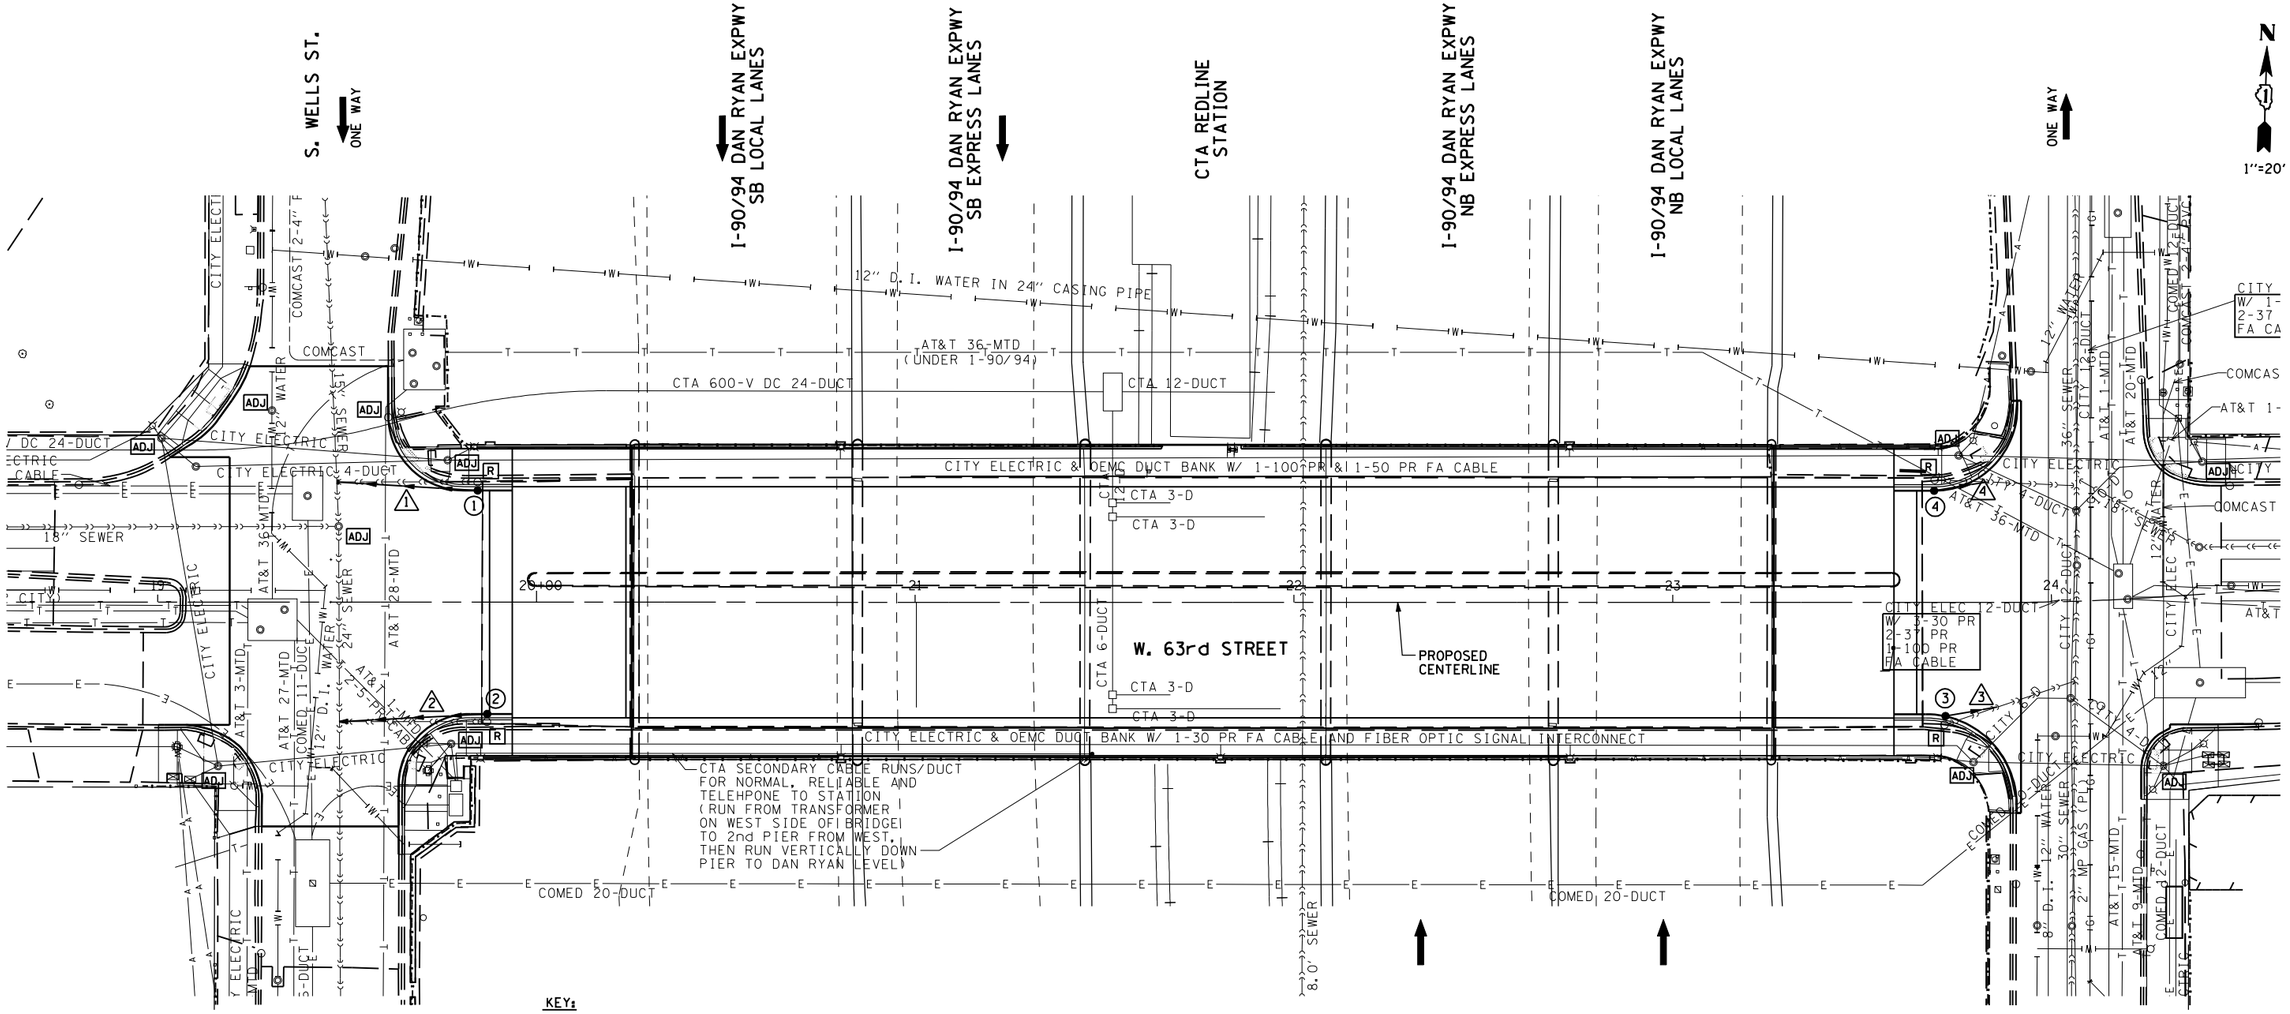

KEY:

- ADJ STRUCTURE TO BE ADJUSTED
- R STRUCTURE TO BE REMOVED
- ● (1) PROPOSED STRUCTURE
- (1) PROPOSED SEWER

STRUCTURE NO.	LOCATION STATION	LOCATION OFFSET	STRUCTURE TYPE	ELEVATION RIM	ELEVATION INV
1	19+84.5	29.5' LT	CB, TY A, 4' DIA., TYPE 1 FRAME, OPEN LID (CITY OF CHICAGO)	599.92	594.75
2	19+87	29.5' RT	CB, TY A, 4' DIA., TYPE 1 FRAME, OPEN LID (CITY OF CHICAGO)	600.22	595.05
3	23+72	30' RT	CB, TY A, 4' DIA., TYPE 1 FRAME, OPEN LID (CITY OF CHICAGO)	600.41	595.24
4	23+69	29.5' LT	CB, TY A, 4' DIA., TYPE 1 FRAME, OPEN LID (CITY OF CHICAGO)	600.43	595.26

NOTES:

SEWER STRUCTURE RIMS ARE GIVEN AT THE FLOWLINE ELEVATIONS.

DRAINAGE STRUCTURES AND SEWER TO BE REMOVED WITHIN THE PROPOSED SEWER TRENCH ARE INCLUDED IN THE COST OF THE NEW SEWER, AND ARE NOT PAID FOR SEPARATELY.

PIPE NO.	LOCATION FROM STRUCTURE	SIZE & MATERIAL	LENGTH	SLOPE
1	(1) TO MAINLINE SEWER	STORM SEWER, TYPE 2, 8" ESVCP	36'	1%
2	(2) TO MAINLINE SEWER	STORM SEWER, TYPE 2, 8" ESVCP	38'	1%
3	(3) TO MAINLINE SEWER	STORM SEWER, TYPE 2, 8" ESVCP	12'	1%
4	(4) TO MAINLINE SEWER	STORM SEWER, TYPE 2, 8" ESVCP	12'	1%